







## LEGEND



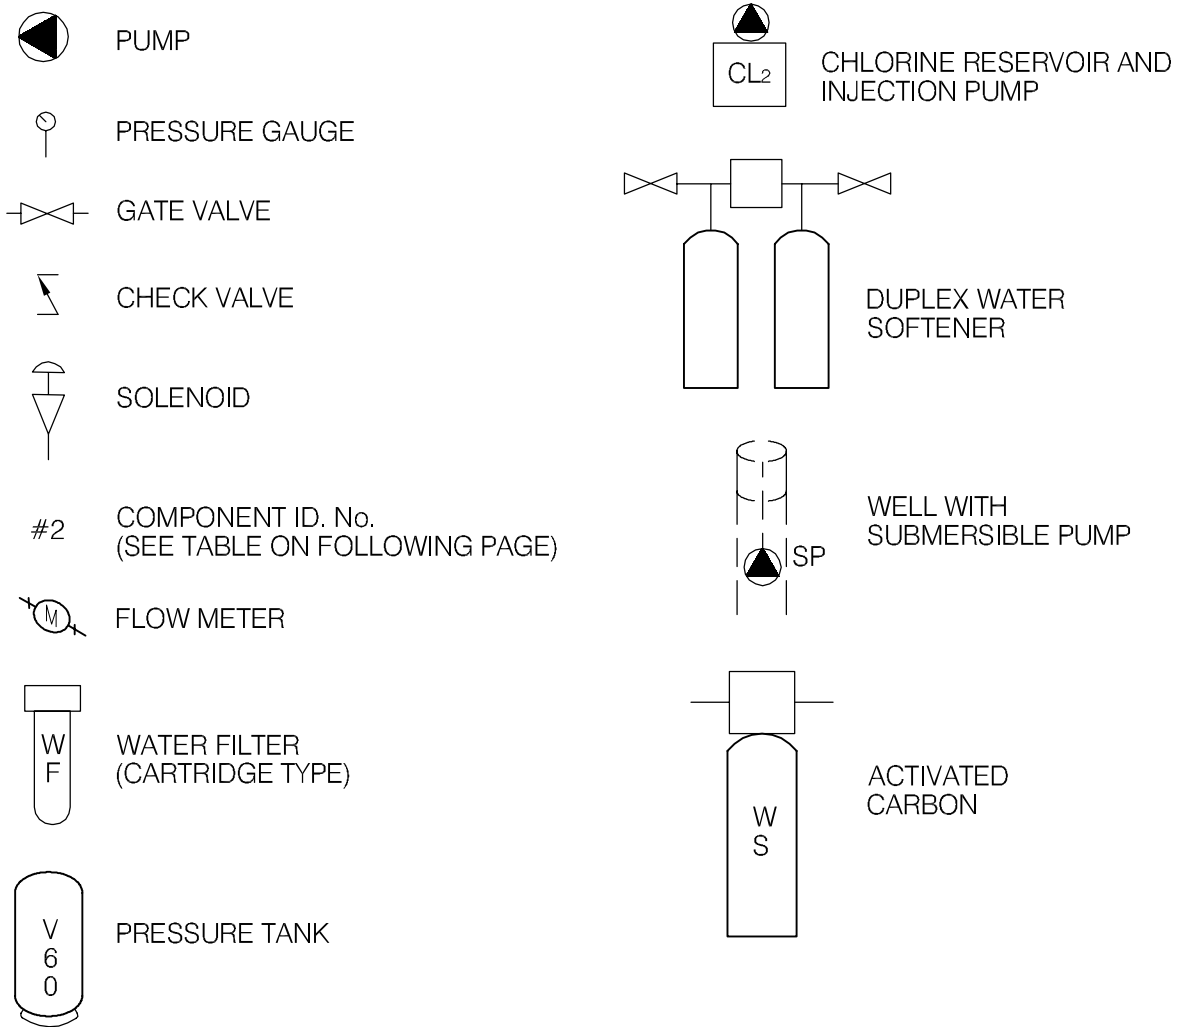

Z:\0201\Drawings\1260002 Water Assessment YTG\001 - Whitehorse Region\1260002003 Whitehorse Schematic\_LEGEND.dwg, 4/11/2006 10:28:07 AM, Adobe PDF, jbuyck

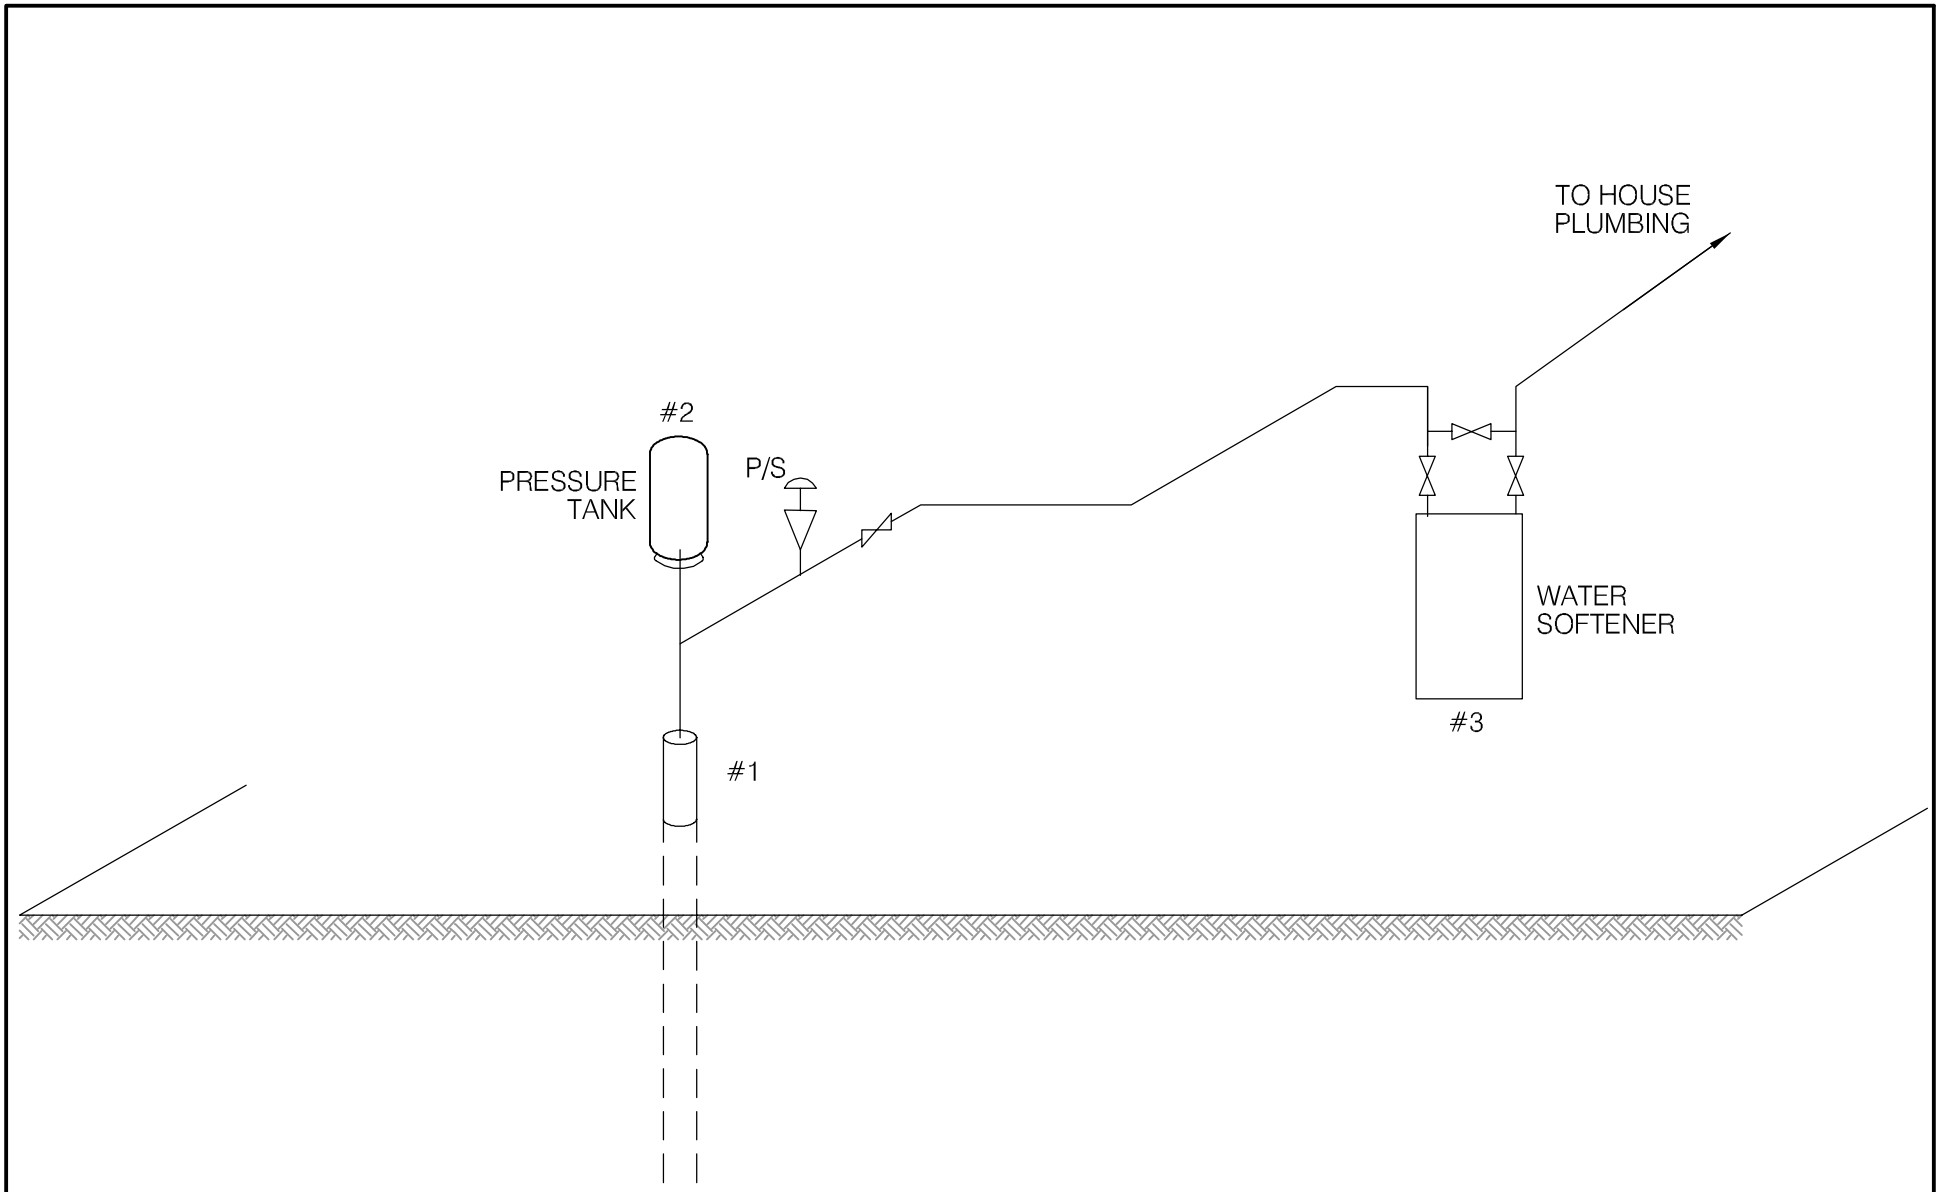 <b>EBA Engineering Consultants Ltd.</b>	PROJECT SMALL PUBLIC WATER SYSTEMS ASSESSMENT WHITEHORSE REGION
CLIENT <div style="text-align: center; margin-top: 10px;">                       Highways and Public Works                      Property Management Branch                 </div>	TITLE <div style="text-align: center; margin-top: 10px;"> <b>SCHEMATIC SYSTEM LEGEND</b> </div>
DATE APRIL 2006    DWN. JSB    CHKD. RMM	FILE NO. 1260002    DRWG. LEGEND



SCHEMATIC PRODUCED BY BERT ALBISSER OF AQUA TECH SUPPLIES & SERVICES LTD.

 <b>EBA Engineering Consultants Ltd.</b>		PROJECT SMALL PUBLIC WATER SYSTEMS ASSESSMENT WHITEHORSE REGION	
CLIENT 		TITLE WATER SYSTEM DISTRIBUTION/TREATMENT SCHEMATIC SYSTEM ID.: M0201 RCMP HOUSING	
DATE	APRIL 2006	DWN.	JSB
CHKD.	FMM	FILE NO.	1260002.001
		DWG.:	FIGURE M0201B

Whitehorse Region – R.C.M.P. Housing  
Building # MO201

DISTRIBUTION & TREATMENT SYSTEM DATA

Item	Description	Manufacturer	Model	Part No.	Serial No.	Size
1	SUB Pump 4"		ZWIRE			4" - 1/2 HP.
2	P/TANK	CHALLENGER	JR25			3/4" 8.5 GAL.
3	SOFTENER	PETWA	CALCOMP-30MI			30K GRAN
4	PRESSURE SWITCH	SQ. D	FSG-2			1/4" FIAT
5						
6						
7						
8						
9						
10						

**TABLE M0201 - 1: SUMMARY OF BACTERIOLOGICAL RESULTS**

		Number of Sampling Events	Time Period over which Sampling was Done	Any Positive Total Coliform Results? (yes or no)	Fraction of Positive Total Coliform Results vs. Total Sampling Events	Any positive E.Coli results? (yes or no)	Most Recent Sampling Event Available for EBA Review	Is Most Recent Result Positive?
Building #	Building Name							
M0201	R.C.M.P Housing	7	Sept-04 to Mar-05	no	0/7	no	4-Mar-05	no



Table M0201-2: Water Quality Results

SOURCE:		Building M0201 - R.C.M.P. Housing			GCDWQ Criteria		
Location/ Resident		Carmacks					
Address		528 Rawlinson St					
Treatment		No					
Source of Water		On-Site Well					
Purpose of Sampling		Baseline	Additional Sampling	Baseline			
Sample Location		Kitchen Tap	Downstairs Laundry Tub Tap				
Date Sampled		5-Oct-04	13-May-05	6-Jul-06	Lower Limit	Upper Limit	
Physical Tests (ALS)					AO	MAC	AO
Colour (CU)		10		<5			15
Conductivity (uS/cm)		309		326			
Total Dissolved Solids		190		200			500
Hardness CaCO3		174		157	AO >200 = poor, > 500 unacceptable <sup>A</sup>		
pH		7.9		8.25	6.5		8.5
Turbidity (NTU)		<b>1.5</b>		<b>2.30</b>		1	5
UV Absorbance			<0.0010				
<b>Dissolved Anions (ALS)</b>							
Alkalinity-Total CaCO3		171		178			
Chloride Cl		1		0.57			250
Fluoride F		0.21		0.173		1.5	
Sulphate SO4		14.8		14.3			500
Nitrate Nitrogen N		<0.1		<0.10		10	
Nitrite Nitrogen N		<0.05		<0.10		1	
Ammonia Nitrogen N							
<b>Total Metals (ALS)</b>							
Aluminum T-Al		<0.02		<0.010			
Antimony T-Sb		0.0007		<0.0005		0.006	
Arsenic T-As		0.0017		0.00198		0.025	
Barium T-Ba		0.0779		0.079		1	
Boron T-B		<0.02		<0.10		5	
Cadmium T-Cd		<0.0002		<0.0002		0.005	
Calcium T-Ca		52.5		47.4			
Chromium T-Cr		0.001		<0.0020		0.05	
Copper T-Cu		<0.001		0.0011		1	
Iron T-Fe		<b>0.371</b>		<b>0.324</b>			0.3
Lead T-Pb		<0.0001		<0.0010		0.01	
Magnesium T-Mg		10.9		9.29			
Manganese T-Mn		<b>0.077</b>		<b>0.0643</b>			0.05
Mercury T-Hg		<0.0002		<0.00020		0.001	
Potassium T-K		2.3		2.16			
Selenium T-Se		<0.0004		<0.0010		0.01	
Sodium T-Na		6		6.2			200
Uranium T-U		0.0009		0.00075		0.02	
Zinc T-Zn		0.026		0.054			5
<b>Dissolved Metals</b>							
Aluminum D-Al						0.1	
Antimony D-Sb						0.006	
Arsenic D-As						0.025	
Barium D-Ba						1.0	
Boron D-B						5	
Cadmium D-Cd						0.005	
Calcium D-Ca							
Chromium D-Cr						0.05	
Cobalt D-Co							
Copper D-Cu							1.0
Iron D-Fe			<0.030				0.3
Lead D-Pb						0.01	
Lithium D-Li							
Magnesium D-Mg							
Manganese D-Mn			<b>0.0680</b>				0.05
Mercury D-Hg						0.001	
Molybdenum D-Mo							
Nickel D-Ni							
Selenium D-Se						0.01	
Silver D-Ag							
Sodium D-Na							200
Uranium D-U						0.02	
Zinc D-Zn							5.0
<b>Field Chemistry (EBA)</b>							
pH			7.79		6.5		8.5
TDS			162				500
EC (uS/cm)			317				
Temperature			12.4				
Free Available Chlorine							

Notes:

A. Guidelines indicated for hardness are not CDWQG, rather they are general aesthetic guidelines - exceedences are indicated in yellow highlighting.

Shading indicates exceedence of Proposed MAC guideline (arsenic).

**Underline with Yellow shading** indicates exceedence of CDWQG MAC

Results are expressed as milligrams per litre except for pH and Colour (CU), Conductivity (umhos/cm), Temperature and Turbidity (NTU)

< = Less than the detection limit indicated.

AO = Aesthetic Objective

MAC = Maximum Acceptable Concentration (Health Based)



**Table M0201-3: Summary of Well Assessment Results  
SMALL PUBLIC DRINKING WATER SYSTEMS**

<b>Well Identification and Location</b>					
<b>Building #</b>	<b>Building Name</b>	<b>Location</b>	<b>Northing (+/- 10 m)</b>	<b>Easting (+/- 10 m)</b>	<b>Grade Elevation (+/- 10 m)</b>
MO201	R.C.MP. Housing	Carmacks	6884996	432277	530

<b>Well Details</b>							
<b>Well Casing Diameter (mm)</b>	<b>Year Well Installed</b>	<b>Well Log?</b>	<b>Well Depth (m bg)</b>	<b>Reported Low Permeabilty Protective Layer?</b>	<b>Pump Setting (m bg)</b>	<b>Well Capacity - Tested, or Reported by User</b>	<b>Static Water Level Below Ground (m-btwc)</b>
150	?	No	?	No, shallow well	?	1/2hp submersible pump Size of pump meets needs	?

<b>Well Construction Details</b>				
<b>Wellhead Above ground (m)</b>	<b>Well Cap</b>	<b>Well Screen</b>	<b>Surface Seal</b>	<b>Apron Grading</b>
0.5 below grade	Split Cap Gasket	?	Unlikely	Inside building

**Table M0201-4: Potential Contaminant Sources  
Building M0201 – RCMP Housing**

<b>Potential Contaminant Source</b>	<b>Potential Contaminants</b>	<b>Distance from Water Source</b>	<b>Northing</b>	<b>Easting</b>
Dump or Landfill	<i>Organic</i> and inorganic chemicals.	1800 m		
Cemetery	<i>Biological</i> <sup>1</sup> , inorganic <sup>2</sup> and organic parameters.	400 m		
Sewage lagoon	<i>Biological</i> , inorganic and organic parameters.	>300 m		
Sewage lines, tanks and lift stations	<i>Biological</i> , inorganic and organic parameters.	<b>&lt;15 m to service lines and &lt;30 m to main</b>		
Septic fields	<i>Biological and Inorganic</i> parameters.	>150 m		
Gas stations	<i>Organic and Inorganic</i> parameters.	600 m		
Undergrounds Fuel Storage Tanks (USTs)	<i>Organic</i> parameters.	>>30 m		
Above ground storage tanks (ASTs)	<i>Organic parameters.</i>	<b>3 m and 24 m</b>	6884995 6885001	432274 432251
Naturally occurring sources of contamination	<i>Radionuclides, Bacteria and Viruses from surfacewater sources.</i>	75 m		

**Notes:** *Bold highlighting of distances indicates non-compliance with proposed guidelines*

1- Biological parameters include: bacteria, viruses, protozoa (parasitic organisms), helminthes (intestinal worms), and bio aerosols (inhalable moulds and fungi).

2 – Inorganic contaminants could include arsenic in embalming chemicals (prior to early 1900's), and heavy metals in caskets.

**Required Setback Distances Draft Guidelines for Part III – Small Public Drinking Water Systems:**

300 m (1,000 ft) from a sewage lagoon or pit and manure heaps

120 m (400 ft) from a solid waste dump or a cemetery

30 m (100 ft) from any other potential source of contamination

\* No Well Log

# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

## SMALL PUBLIC WATER SYSTEM ASSESSMENT

### PART A: EBA Site Inspection

Inspector: Ryan Marlett  
Luke Lebel

Date May 13, 2005

WELL ID #	Owner	Location Description
MO207	RCMP	RCMP Housing Rawlinson st

#### 1. Well Location and Potential Contaminant Sources

a. General location of well: (Community, Subdivision, etc.)

Carmacks

b. Specific location: (Road or street, Building number, name of owner and/, legal description,

528 Rawlinson st

c. GPS location: 432277 Easting 6884996 Northing

d. Is there electric power?  Yes  No

e. Does the well system have:

15 or more service connections to a piped distribution system? If so how many \_\_\_\_\_

Services 1 RCMP residence

5 or more delivery sites on a trucked distribution system? If so how many \_\_\_\_\_

f. Nearest building, specify Located directly beside residence with access from basement

g. Distance from well to building \_\_\_\_\_

h. If there is an effluent disposal field, is its location known?  Yes  No

i. Distance from well to nearest point of known field: \_\_\_\_\_

j. Well location relative to field:  upslope  downslope  lateral

# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

k. Is there any part of a sewage disposal system(s) or other potential sources of pollution that may pose a health and safety risk within 30 m?  Yes  No

l. Is the well located within 300 m from a sewage lagoon or pit?  Yes  No

m. Is the well located within 120 m from a solid waste site or dump, cemetery?  Yes  No

*There is a hill cemetery up gradient ~ 500m on a hill near by*

n. Is the infrastructure protecting the wellhead, pumphouse, storage tank and/or water treatment plant designed and secured to prevent:

Unauthorized access by humans?  Yes  No  
*Can only be accessed through residence*

Entrance by animals?  Yes  No  
*There are cobwebs and traces of mice present*

o. Is well site subject to flooding?  Yes  No  
*There is some dampness and staining in the plywood*

p. Is the well site well drained?  Yes  No

q. Is there a buried fuel tank on the property?  Yes  No *very unlikely*

If yes, is it  in use  abandoned

Is the location known?  Yes  No

Distance from the well to known buried tank \_\_\_\_\_

r. Are there any other known contaminant sources on the property?

Yes  No Describe \_\_\_\_\_

If yes, specify the source:  dump  sewage lagoon  cemetery  other

Potential Source 1: AST 1; Distance from well to Potential Source 1: ~3m

Potential Source 2: AST 2; Distance from well to Potential Source 2: ~24m

Potential Source 3: \_\_\_\_\_; Distance from well to Potential Source 3: \_\_\_\_\_

Potential Source 4: \_\_\_\_\_; Distance from well to Potential Source 4: \_\_\_\_\_

s. Are there other wells on this property?  Yes  No

*There is an adjacent well ~ 22m away*

How many? \_\_\_\_\_  in use  abandoned  require proper sealing

# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

## 2. Well and Wellhead information:

- \*a. When was well installed? Year \_\_\_\_\_ Month \_\_\_\_\_
- b. Type:  drilled  dug  sand point  other \_\_\_\_\_
- \*c. Is there a drillers log for the well:  Yes  No
- d. Is there a surface seal to 6 m  Yes  No  unknown  unlikely
- e. Surface casing:  Yes Diameter \_\_\_\_\_  No
- f. Well casing: Diameter 15cm Material:  steel  plastic  concrete
- \*g. Depth of well: ~40ft  measured (if possible)  reported  from log
- \*h. Static water level below ground: ~20ft *educated guess from base upon geology of the area and characteristics of surrounding wells*  
 measured (if possible)  reported  from log  flowing
- \*i. (If granular) Is the well completed:  open end casing  with a well screen  
 with slotted pipe  unknown other \_\_\_\_\_
- \*j. (If bedrock) Does the well have a liner?  yes  No  steel  plastic
- \*k. If there is a well screen: length \_\_\_\_\_ slot size(s) \_\_\_\_\_  
Location of screen: from \_\_\_\_\_ to \_\_\_\_\_ from log reported
- \*l. Is there a sump below the screen?  Yes  No
- m. Is the well head:  in pumphouse  in pit  pitless adaptor  in a building  
*Attached to basement of residence, enclosed w/ purl and non-purl and a thin casing on the top*  
 in a wooden enclosure other, describe \_\_\_\_\_
- n. If the well head is located in a wooden enclosure,

# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

- i. Is the well head below grade? describe in detail Yes, ~0.5m below grade
- ii. Are there signs of ponding on the enclosure (e.g. water stains, etc.)?  Yes  No  
There is some wetness and water stains near and on the ground. Rusting on wellhead
- iii. Is the wellhead enclosed by fiberglass insulations?  Yes  No
- iv. Any evidence of rodents? Specify There is some evidence of mouse droppings and cobwebs
- v. Does the well casing have a proper seal cap?  Yes  No  
split seal gasket  
If no, describe condition \_\_\_\_\_

### 3. Water Supplying This Well:

- a. By definition is the water from a surface water source or under the direct influence of surface water?  
 Yes  No  farther investigation required.

If yes is there treatment  Yes  No

Explain (filtration, disinfection etc...) \_\_\_\_\_

### 4. Aquifer Supplying This Well:

- a. The aquifer is:  bedrock  granular sediment  unknown
- b. Does water level and/or well capacity show seasonal fluctuation?  Yes  No

### 5. Pump Installation:

- a. Is the well equipped with a pump?  yes  No
- b. Type of pump:  hand  electric submersible  jet  
 shallow well centrifugal  other, \_\_\_\_\_
- c. Description: Manufacturer \_\_\_\_\_ Model \_\_\_\_\_  
horsepower \_\_\_\_\_ capacity \_\_\_\_\_ voltage \_\_\_\_\_

# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

d. Date installed: \_\_\_\_\_ By: \_\_\_\_\_

e. For submersible pump, depth of setting below surface \_\_\_\_\_

f. Drop pipe for submersible pump:  steel  plastic

g. Pump delivers water to:  pressure tank  elevated tank  other

h. Are there automatic pump controls:  Yes  No

i. Is there provision for taking water samples before water reaches storage?  Yes  No

j. Is there a water meter on the system?  Yes  No

k. Is the pump and piping protected from freezing?  Yes  No

l. Comments on pump installation: If yes, describe: Heat trace and is located within an insulated compartment off from a heated house

## 6. Conclusions

a. Comments on overall installation:

---

---

---

---

---

---

---

---

b. Recommendations:

---

---

---

---

---

---

---

---

# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

## PART B: EBA Site Inspection

Inspector: \_\_\_\_\_

Date \_\_\_\_\_

WELL ID #	Owner	Location Description
M0201	YTG.	RCHP CARNAACKS FORMER YUKON HOUSING.

### 6. Water Treatment

a. Is well water treated?  Yes  No; Type of treatment: SOFTNER - NO SALT

chlorination  iron and or manganese removal  other \_\_\_\_\_

b. Is water entering plumbing or piped distribution system treated with chlorine or another treatment that is as effective as chlorine used to achieve disinfection throughout the system?

Yes  No If so how \_\_\_\_\_

c. If treated with chlorine, is the free residual chlorine concentration less than 0.2 mg/L

Yes  No \_\_\_\_\_ reading.

Tested at \_\_\_\_\_ (location)

d. Is testing for chlorine residual concentration done at the tap (eg. Kitchen faucet) or from representative points in a piped distribution system, including a point from tap at the end line

Yes  No If yes how often? \_\_\_\_\_

e. If the drinking water is being transported by water delivery truck does it have a minimum chlorine free residual of 0.4 mg/L at the time of fill.  Yes  No

### 7. Water Quality (observations):

a. Does the water stain plumbing?  yes  No  slight  severe

Type of stain:  brown  red  black

b. Does the water contain sediment?  Yes  No  occasional  constant

c. Is there an unpleasant odour?  Yes  No  H<sub>2</sub>S  Other \_\_\_\_\_

# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

- d. Is there an unpleasant taste?  Yes  No  brackish  Other \_\_\_\_\_
- e. Is there a history of bad bacterial analyses?  Yes  No
- f. Is there a chemical analysis?  Yes  No  adequate  incomplete
- g. Is there analysis of trihalomethanes (THMs) where the water source is a surface water supply or a well under the direct influence of surface water?  Yes  No
- h. Is the drinking water tested daily with an accurate reading chlorine test kit capable of reading in the range 0 to 3.5 mg/L of free chlorine residual in increments of 0.1mg/L?  Yes  No  unknown
- i. If yes is the test performed in accordance with manufactures directions?  Yes  No  unknown
- j. Is a record of the date, time, name of person performing the test and results of the drinking water sample kept?  Yes  No

## TANK AND PIPING DETAILS

### *Tank Room*

Is there a water tank?  Yes  No Details:

Where is it located?

Comments:

JR25 Pressure Tank.

Is the room in which the water tank is located heated to maintain an optimum temperature of 4°C for stored water?

YES  NO

Comments: \_\_\_\_\_

Are there windows in the add-on that may allow direct sunlight onto the water holding tank? YES

NO

Comments: \_\_\_\_\_

Are there other heat sources near the tank? YES  NO

Comments: \_\_\_\_\_

Is there waterproof flooring with a sealed base to contain spills? YES  NO

Comments: \_\_\_\_\_

# **EBA Engineering Consultants Ltd.**

Creating and Delivering Better Solutions

---

## ***Overall Tank***

What are the tank size and dimensions?

\_\_\_\_\_

What material is the tank constructed of? \_\_\_\_\_

Is tank and associated piping constructed of safe materials (i.e. CSA approved and material that does not affect the taste of the water)? YES NO

Comments: \_\_\_\_\_

## ***Tank Inlet, Outlet and Lid***

Is there adequate access on the tank for cleaning (i.e. min 15" access lid)? YES NO

Does the lid have a tight seal and is it watertight when closed? YES NO

Does the tank have an overflow or high level whistle? YES NO

Is the water tank drain accessible? YES NO

## **WATER TANK AND WATER QUALITY CONDITION**

Are there signs of staining or biofouling? YES NO

Comments: \_\_\_\_\_

Is there any sediment or scum in bottom of tank? YES NO

Comments: \_\_\_\_\_

Is there any odour associated with the water or tank? YES NO

Have there been any bacteriological analyses conducted previously? YES NO

Does the tank appear that it has been cleaned recently? YES NO

Are the tanks easily assessed for the purpose of cleaning and disinfection? YES NO

## **8. Conclusions**

### **a. Comments on overall installation:**

THIS SYSTEM IS A BARELY ADEQUATE SETUP.  
THE SOFTNER APPEARS TO BE NEGLECTED  
AS THERE IS NO SALT IN THE BRINE  
TANK. NO FILTRATION OR BACTERIAL  
TREATMENT IS IN PLACE. THE PUMP  
IS VERY NOISY AND MAY FAIL SOON

### **b. Recommendations:**

SYSTEM SHOULD BE UPGRADED WITH  
PROPER PUMP & PRESSURE TANK  
INSTALLATION. THE SOFTNER SHOULD  
BE PUT BACK IN SERVICE AND  
A UV SYSTEM SHOULD BE INSTALLED.  
THE WELL HEAD SHOULD BE UPGRADED  
TO THE NEW REGS UP COMING.



**Photo 0166:** M0201 Wellhead (front below paneling), R.C.M.P. Residence (behind) and Above Ground Storage Tank (center)

**Photo 0167:** M0201 Wellhead and Pressure Tank

