


NOTES:



1. UTM COORDINATES OBTAINED WITH A HAND HELD GPS USING NAD83 SYSTEM AND ARE CONSIDERED TO BE ACCURATE TO 10.0 m, APPROXIMATELY.


30 m RADIUS FROM WATER WELL FOR CONSIDERATION OF PROXIMITY TO POTENTIAL CONTAMINANT SOURCES.

[illegible]

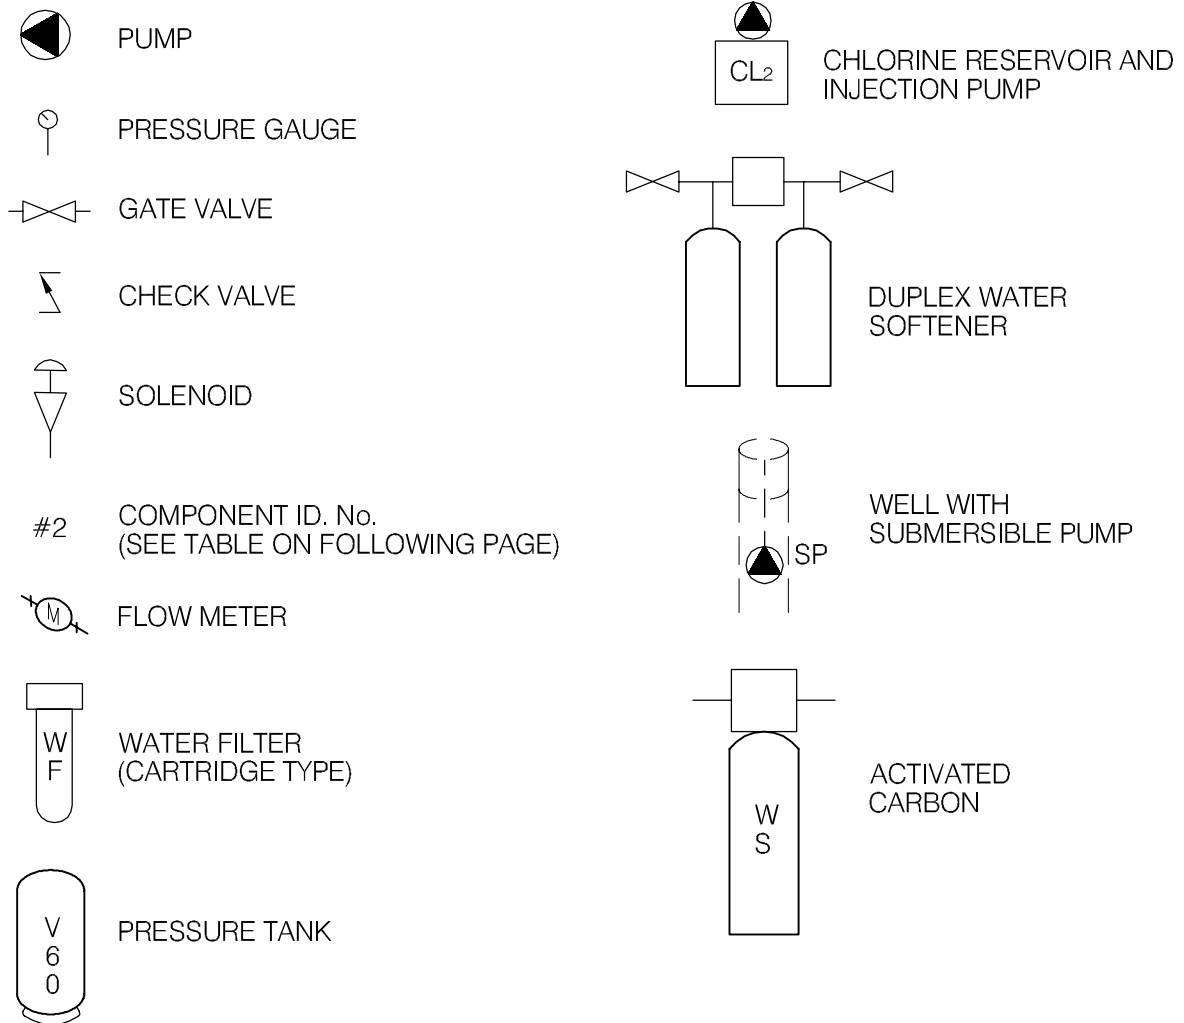

LEGEND

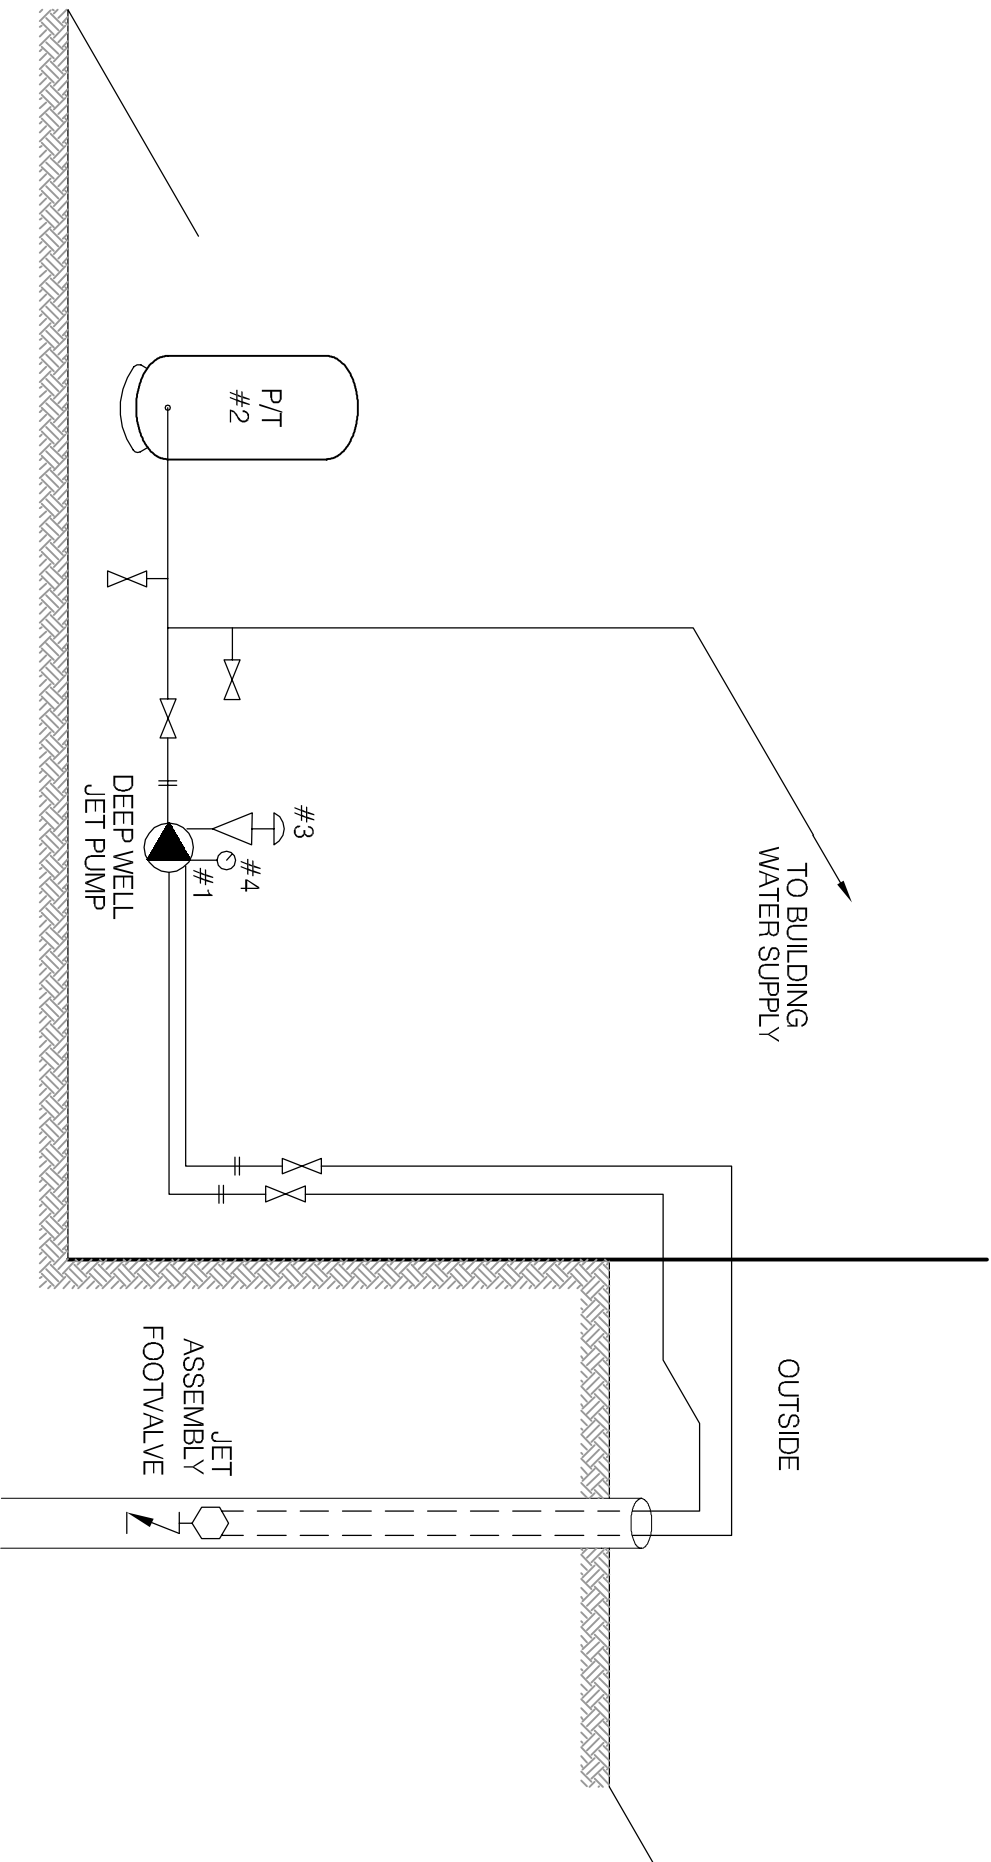

 EBA Engineering Consultants Ltd.			PROJECT SMALL PUBLIC WATER SYSTEMS ASSESSMENT WESTERN REGION		
CLIENT			TITLE		
 Highways and Public Works Property Management Branch			SCHEMATIC SYSTEM LEGEND		
DATE	APRIL 2006	DWN.	JSB	CHKD.	RMM
FILE NO.	1260002	DRWG.	LEGEND		



SCHEMATIC PRODUCED BY BERT ALBISSER OF AQUATECH SUPPLIES AND SERVICES LTD.

<div>EBA Engineering Consultants Ltd.</div>				PROJECT SMALL PUBLIC WATER SYSTEMS ASSESSMENT WESTERN REGION					
<div>Yukon Highways and Public Works Property Management Branch</div>				TITLE WATER SYSTEM DISTRIBUTION/TREATMENT SCHEMATIC SYSTEM ID.: 3201 BURWASH LANDING AIRPORT					
DATE	SEPT. 2005	DWN.	JSB	CHKD.	FMN	FILE NO.	1260002.003	DWG.:	FIGURE 3201-B

Western Region – Burwash Landing Airport Building
Building # 3201

DISTRIBUTION & TREATMENT SYSTEM DATA

Item	Description	Manufacturer	Model	Part No.	Serial No.	Size
1	JET PUMP	MONARCH	MJC-50		2999	1/2 HP
2	PRESSURE TANK	CHALLENGER	PC-66			
3	PRESSURE SWITCH	SQUARE D	FSG-2			2HP-1/4" NPT
4	PRESSURE GAUGE	MONARCH	2"-0-100 PSI			2" - 1/4" NPT
5						
6						
7						
8						
9						
10						

TABLE 3201- 1: SUMMARY OF BACTERIOLOGICAL RESULTS

Building #	Building Name	Number of Sampling Events	Time Period over which Sampling was Done	Any Positive Total Coliform Results? (yes or no)	Fraction of Positive Total Coliform Results vs. Total Sampling Events	Any positive E. Coli results? (yes or no)	Most Recent Sampling Event Available for EBA Review	Is Most Recent Result Positive?
3201	Burwash Landing Airport Building	11	Sept-04 to Jun-05	yes	2/11	no	16-Jun-05	no



Table 3201-2: Water Quality Results

SOURCE:		Building 3201 - Burwash Landing Airport Building			GCDWQ Criteria		
Location/ Resident		Burwash Landing					
Address							
Treatment		None					
Disinfection		None					
Source of Water		On-site well					
Purpose of Sampling		Base Line	Base Line	Additional Analytical			
Sample Location				Kitchen tap			
Date Sampled		21-Sep-04	15-Jun-05	28-Jul-05	Lower	Upper Limit	
Physical Tests (ALS)					AO	MAC	AO
Colour (CU)		<5	<5.0	-			15
Conductivity (uS/cm)			622	-			
Total Dissolved Solids		370	402	-			500
Hardness CaCO3		334	329	-	AO >200 = poor, > 500 unacceptable ⁶		
pH		7.95	8.20	-	6.5		8.5
Turbidity (NTU)		0.40	0.64	-		1	5
UV Absorbance				0.119			
% UV Transmittance				76.0			
Dissolved Anions (ALS)							
Alkalinity-Total CaCO3		243	247	-			
Chloride Cl		6.6	4.23	4.36			250
Fluoride F		0.18	0.238	-		1.5	
Silicate SiO4				-			
Sulphate SO4		89.8	99.3	-			500
Nitrate Nitrogen N		1.7	1.44	1.59		10	
Nitrite Nitrogen N		<0.05	<0.10	<0.0010		3.2	
Ammonia Nitrogen N				0.020			
Total Phosphate PO4				-			
Total Metals (ALS)							
Aluminum T-Al		0.006	<0.010	-			
Antimony T-Sb		0.0003	<0.00050	-		0.006	
Arsenic T-As		0.0006	0.00037	-		0.025	
Barium T-Ba		0.038	0.025	-		1	
Boron T-B		0.062	<0.10	-		5	
Cadmium T-Cd		<0.00001	<0.00020	-		0.005	
Calcium T-Ca			91.9	-			
Chromium T-Cr		0.0008	<0.0020	-		0.05	
Copper T-Cu		1.12	0.793	0.645		1	
Iron T-Fe		0.02	0.059	-			0.3
Lead T-Pb		0.0004	0.0012	-		0.01	
Magnesium T-Mg			24.2	-			
Manganese T-Mn		<0.005	<0.0020	-			0.05
Mercury T-Hg			<0.00020	-		0.001	
Potassium T-K			4.42	-			
Selenium T-Se			0.0011	-		0.01	
Sodium T-Na		5.9	5.3	-			200
Uranium T-U		0.0024	0.00220	-		0.02	
Vanadium T-V				-			
Zinc T-Zn		0.012	<0.050	-			5
Dissolved Metals (ALS)							
Aluminum D-Al				-		0.1	
Antimony D-Sb				-		0.006	
Arsenic D-As				-		0.025	
Barium D-Ba				-		1.0	
Boron D-B				-		5	
Cadmium D-Cd				-		0.005	
Calcium D-Ca				-			
Chromium D-Cr				-		0.05	
Copper D-Cu				0.647			1.0
Iron D-Fe				-			0.3
Lead D-Pb				-		0.01	
Magnesium D-Mg				-			
Manganese D-Mn				-			0.05
Mercury D-Hg				-		0.001	
Potassium D-K				-			
Selenium D-Se				-		0.01	
Sodium D-Na				-			200
Uranium D-U				-		0.02	
Vanadium D-V				-			
Zinc D-Zn				-			5.0
Organic Parameters							
Tannin and Lignin				0.13			
Total Organic Carbon C				7.14			
Extractable Hydrocarbons							
EPI110-19				<0.30			
EPI119-32				<1.0			
LEPH				-			
HEPH				-			
Field Chemistry (EBA)							
pH				7.95	6.5		8.5
TDS (ppm)				284			500
EC (uS/cm)				575			
Temperature (°C)				4.8			
Free Available Chlorine							

Notes:

A. Guidelines indicated for hardness are not CDWQG, rather they are general aesthetic guidelines
- exceedences are indicated in yellow highlighting.

Italics and underline indicates exceedence of proposed MAC (ie. arsenic)

Bold with Yellow highlighting indicates exceedence of CDWQG Aesthetic Objective (AO)

Bold Underline with Yellow highlighting indicates exceedence of CDWQG MAC

Results are expressed as milligrams per litre except for pH and Colour (CU)

Conductivity (umhos/cm), Temperature (°C) and Turbidity (NTU)

< = Less than the detection limit indicated.

AO = Aesthetic Objective

MAC = Maximum Acceptable Concentration (Health Based)



SMALL PUBLIC WATER SYSTEM ASSESSMENT**PART A: EBA Site Inspection**Inspector: Ryan Martin, Luke LebelDate July 28, 2005

WELL ID #	Owner	Location Description
3201	YTG	Burwash Airport Building

1. Well Location and Potential Contaminant Sources

a. General location of well: (Community, Subdivision, etc.)

Burwash

b. Specific location: (Road or street, Building number, name of owner and/, legal description,

Burwash Airportc. GPS location: N 6805564 E 605217 elev 802m \pm 8md. Is there electric power? ☒ Yes ☐ Noe. Is there outside water access? ☒ Yes ☐ No

f. Does the well system have:

☐ 15 or more service connections to a piped distribution system? If so how many _____Burwash Airport☐ 5 or more delivery sites on a trucked distribution system? If so how many _____g. Nearest building, specify Burwash Airport Terminal Buildingh. Distance from well to building ~ 1 mi. If there is an effluent disposal field, is its location known? ☒ Yes ☐ Noj. Distance from well to nearest point of known field: 23m to tank, field @ ~40mk. Well location relative to field: ☐ upslope ☒ downslope ☐ lateral

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

l. Is there any part of a sewage disposal system(s) or other potential sources of pollution that may pose a health and safety risk within 30 m? ☒ Yes ☐ No

m. Is the well located within 300 m from a sewage lagoon or pit? ☐ Yes ☒ No unlikely

n. Is the well located within 120 m from a solid waste site or dump, cemetery? ☐ Yes ☒ No unlikely

o. Is the infrastructure protecting the wellhead, pumphouse, storage tank and/or water treatment plant designed and secured to prevent:

Unauthorized access by humans? ☒ Yes ☐ No
fastened shut

Entrance by animals? ☐ Yes ☒ No
wooden enclosure with mouse droppings present

p. Is well site subject to flooding? ☐ Yes ☒ No

q. Is the well site well drained? ☒ Yes ☐ No

r. Is there a buried fuel tank on the property? ☐ Yes ☒ No unlikely

If yes, is it ☐ in use ☐ abandoned

Is the location known? ☐ Yes ☐ No

Distance from the well to known buried tank _____

s. Are there any other known contaminant sources on the property?

☒ Yes ☐ No Describe _____

If yes, specify the source: ☐ dump ☐ sewage lagoon ☐ cemetery ☐ other

Potential Source 1: AST; Distance from well to Potential Source 1: ~8m

Potential Source 2: _____; Distance from well to Potential Source 2: _____

Potential Source 3: _____; Distance from well to Potential Source 3: _____

Potential Source 4: _____; Distance from well to Potential Source 4: _____

t. Are there other wells on this property? ☒ Yes ☐ No

How many? 1 ☐ in use ☒ abandoned ☐ require proper sealing

~1m from existing well

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

2. Well and Wellhead information:

- a. When was well installed? Year unknown Month _____
- b. Type: ☒ drilled ☐ dug ☐ sand point ☐ other _____
- c. Is there a drillers log for the well: ☐ Yes ☒ No
- d. Is there a surface seal to 6 m ☐ Yes ☒ No ☐ unknown ☒ unlikely
- e. Surface casing: ☐ Yes Diameter _____ ☒ No
- f. Well casing: Diameter 15cm Material: ☒ steel ☐ plastic ☐ concrete
- g. Depth of well: 10.51m ☒ measured (if possible) ☐ reported ☐ from log
- h. Static water level below ground: 8.55 m
☒ measured (if possible) ☐ reported ☐ from log ☐ flowing
- i. (If granular) Is the well completed: ☐ open end casing ☐ with a well screen
☐ with slotted pipe ☒ unknown other _____
- j. (If bedrock) Does the well have a liner? ☐ yes ☐ No ☐ steel ☐ plastic
- k. If there is a well screen: length unknown slot size(s) _____
Location of screen: from _____ to _____ from log reported
- l. Is there a sump below the screen? ☐ Yes ☐ No
- m. Is the well head: ☐ in pumphouse ☐ in pit ☐ pitless adaptor ☐ in a building
☒ in a wooden enclosure other, describe _____
- n. If the well head is located in a wooden enclosure,

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

- i. Is the well head below grade? describe in detail well is at grade
- ii. Are there signs of ponding on the enclosure(e.g. water stains, etc.)? ☒ Yes ☐ No
Some
- iii. Is the wellhead enclosed by fiberglass insulations? ☒ Yes ☐ No
- iv. Any evidence of rodents? Specify Mause droppings
- v. Does the well casing have a proper seal cap? ☐ Yes ☒ No

If no, describe condition None present, well is open

3. Water Supplying This Well:

- a. By definition is the water from a surface water source or under the direct influence of surface water?
- ☒ Yes ☐ No ☐ farther investigation required.

If yes is there treatment or disinfection ☐ Yes ☒ No

Explain (filtration, disinfection etc...) _____

4. Aquifer Supplying This Well:

- a. The aquifer is: ☐ bedrock ☒ granular sediment ☐ unknown
likely
- b. Does water level and/or well capacity show seasonal fluctuation? ☐ Yes ☒ No unlikely

5. Pump Installation:

- a. Is the well equipped with a pump? ☒ yes ☐ No
- b. Type of pump: ☐ hand ☐ electric submersible ☒ jet
- ☐ shallow well centrifugal ☐ other, _____
- c. Description: Manufacturer _____ Model _____
horsepower _____ capacity _____ voltage _____

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

d. Date installed: _____ By: _____

e. For submersible pump, depth of setting below surface _____

f. Drop pipe for submersible pump: ☒ steel ☐ plastic
Copper

g. Pump delivers water to: ☒ pressure tank ☐ elevated tank ☐ other

h. Are there automatic pump controls: ☒ Yes ☐ No

i. Is there provision for taking water samples before water reaches storage? ☐ Yes ☒ No

j. Is there a water meter on the system? ☐ Yes ☒ No

k. Is the pump and piping protected from freezing? ☒ Yes ☐ No

If yes, describe: heat trace and insulation

l. Comments on pump installation: _____

6. Conclusions

a. Comments on overall installation:

b.Recommendations: _____

ERA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

PART B: EBA Site Inspection

Inspector: BERT ALBISSER

Date JULY 28/05

WELL ID #	Owner	Location Description
3201	YTG	BURWASH LANDING AIRPORT

6. Water Treatment

a. Is well water treated? ☐ Yes ☒ No; Type of treatment:

☐ chlorination ☐ iron and or manganese removal ☐ other _____

b. Is water entering plumbing or piped distribution system treated with chlorine or another treatment that is as effective as chlorine used to achieve disinfection throughout the system?

☐ Yes ☒ No If so how _____

c. If treated with chlorine, is the free residual chlorine concentration less than 0.2 mg/L

☐ Yes ☒ No _____ reading.

Tested at _____ (location)

d. Is testing for chlorine residual concentration done at the tap (eg. Kitchen faucet) or from representative points in a piped distribution system, including a point from tap at the end line

☐ Yes ☒ No If yes how often? _____

e. If the drinking water is being transported by water delivery truck does it have a minimum chlorine free residual of 0.4 mg/L at the time of fill. ☐ Yes ☒ No

7. Water Quality (observations):

a. Does the water stain plumbing? ☐ yes ☐ No ☒ slight ☐ severe

Type of stain: ☐ brown ☒ red ☐ black

b. Does the water contain sediment? ☐ Yes ☒ No ☐ occasional ☐ constant

c. Is there an unpleasant odour? ☐ Yes ☒ No ☐ H₂S ☐ Other _____

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

- d. Is there an unpleasant taste? ☐ Yes ☒ No ☐ brackish ☐ Other _____
- e. Is there a history of bad bacterial analyses? ? ☐ Yes ☐ No
- f. Is there a chemical analysis? ? ☐ Yes ☐ No ☐ adequate ☐ incomplete
- g. Is there analysis of trihalomethanes (THMs) where the water source is a surface water supply or a well under the direct influence of surface water? ☐ Yes ☒ No
- h. Is the drinking water tested daily with an accurate reading chlorine test kit capable of reading in the range 0 to 3.5 mg/L of free chlorine residual in increments of 0.1mg/L? ☐ Yes ☒ No ☐ unknown
- i. If yes is the test performed in accordance with manufactures directions? ☐ Yes ☒ No ☐ unknown
- j. Is a record of the date, time, name of person performing the test and results of the drinking water sample kept? ☐ Yes ☒ No

TANK AND PIPING DETAILS

Tank Room

Is there a water tank? Yes No Details: PRESSURE TANK

Where is it located?

Comments: MECHANICAL ROOM

Is the room in which the water tank is located heated to maintain an optimum temperature of 4°C for stored water?

YES NO

Comments: _____

Are there windows in the add-on that may allow direct sunlight onto the water holding tank? YES NO

Comments: _____

Are there other heat sources near the tank? YES NO

Comments: _____

Is there waterproof flooring with a sealed base to contain spills? YES NO

Comments: _____

Overall Tank

What are the tank size and dimensions?

What material is the tank constructed of? _____

Is tank and associated piping constructed of safe materials (i.e. CSA approved and material that does not affect the taste of the water)? YES NO

Comments: _____

Tank Inlet, Outlet and Lid

Is there adequate access on the tank for cleaning (i.e. min 15" access lid)? YES NO

Does the lid have a tight seal and is it watertight when closed? YES NO

Does the tank have an overflow or high level whistle? YES NO

Is the water tank drain accessible? YES NO

WATER TANK AND WATER QUALITY CONDITION

Are there signs of staining or biofouling? YES NO

Comments: _____

Is there any sediment or scum in bottom of tank? YES NO

Comments: _____

Is there any odour associated with the water or tank? YES NO

Have there been any bacteriological analyses conducted previously? YES NO

Does the tank appear that it has been cleaned recently? YES NO

Are the tanks easily assessed for the purpose of cleaning and disinfection? YES NO

8. Conclusions

a. Comments on overall installation:

THIS INSTALLATION IS OLD, BUT WORK DONE.
WHEN PUMP NEEDS REPLACING UPGRADE
TO SUB. PUMP SYSTEM

b. Recommendations:

INSTALL TREATMENT IF REQUIRED BY WATER
ANALYSIS FOR UV PRETREATMENT. INSTALL
5 GPM (NSF 55 CERTIFIED) UV SYSTEM
WITH NECESSARY PRETREATMENT - 1 BIG
BLUE 5 MICRON FILTER.

**Photo 0581:** 3201 Burwash Landing Airport Building**Photo 0585:** 3201 Wellhead enclosure**Photo 0577:** 3201 Wellhead. Note open casing.**Photo 0578:** 3201 Insulation around wellhead with evidence of mouse feces

**Photo 05980:** 3201 Septic system**Photo 0579:** 3201 Above ground fuel storage tank**Photo 0584:** 3201 Abandoned well adjacent to existing well**Photo 0114:** 3201 Pressure tank (left), and jet pump (right)