




NOTES:
1. UTM COORDINATES OBTAINED WITH A HAND HELD GPS USING NAD83 SYSTEM AND ARE CONSIDERED TO BE ACCURATE TO 10.0 m, APPROXIMATELY.

 30 m RADIUS FROM WATER WELL FOR CONSIDERATION OF PROXIMITY TO POTENTIAL CONTAMINANT SOURCES.

0	ISSUED FOR CLIENT REVIEW	DD/MM/YY	XXX	
No.	DESCRIPTION	DATE	APPROVED	
REVISION				

**EBA Engineering Consultants Ltd.**

DESIGNED BY:	R. MARTIN
DRAWN BY:	J. BUYCK
DATE:	AUG. 2005
SCALE:	AS SHOWN
PROJECT No.:	1260002.003
ACAD FILENAME:	003-WESTERN REGION

CLIENT:

Highways and Public Works
Property Management Branch


SMALL PUBLIC WATER SYSTEMS ASSESSMENT
WESTERN REGION



GOVERNMENT OF YUKON
HIGHWAYS & PUBLIC WORKS


BEAVER CREEK RCMP
RESIDENCE BUILDING # M0133
SITE LOCATION DIAGRAM
WELL ID: M0133

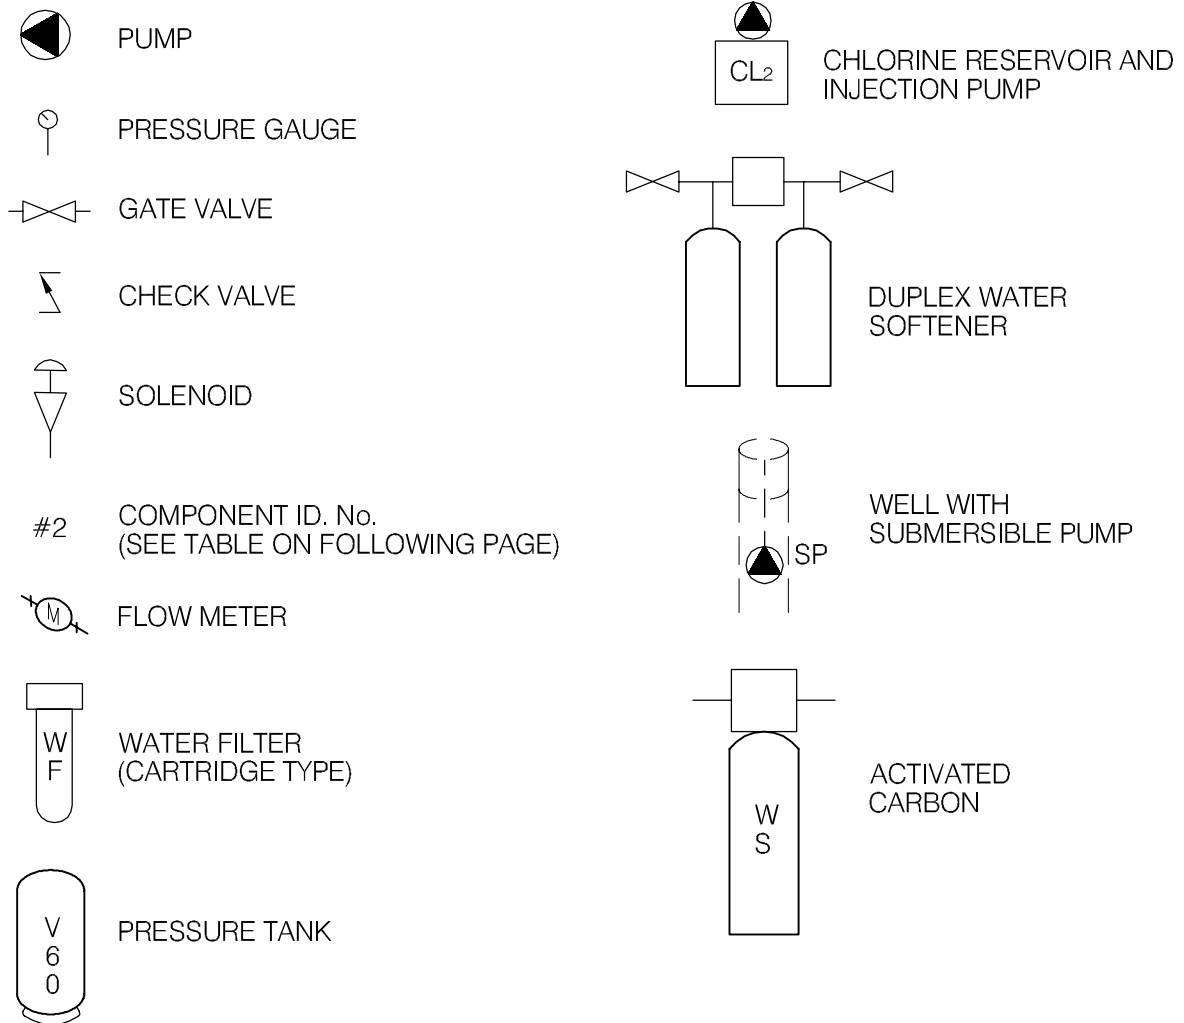

REVISION	ISSUE
	0
FIGURE No.	FIGURE M0133-A

LEGEND

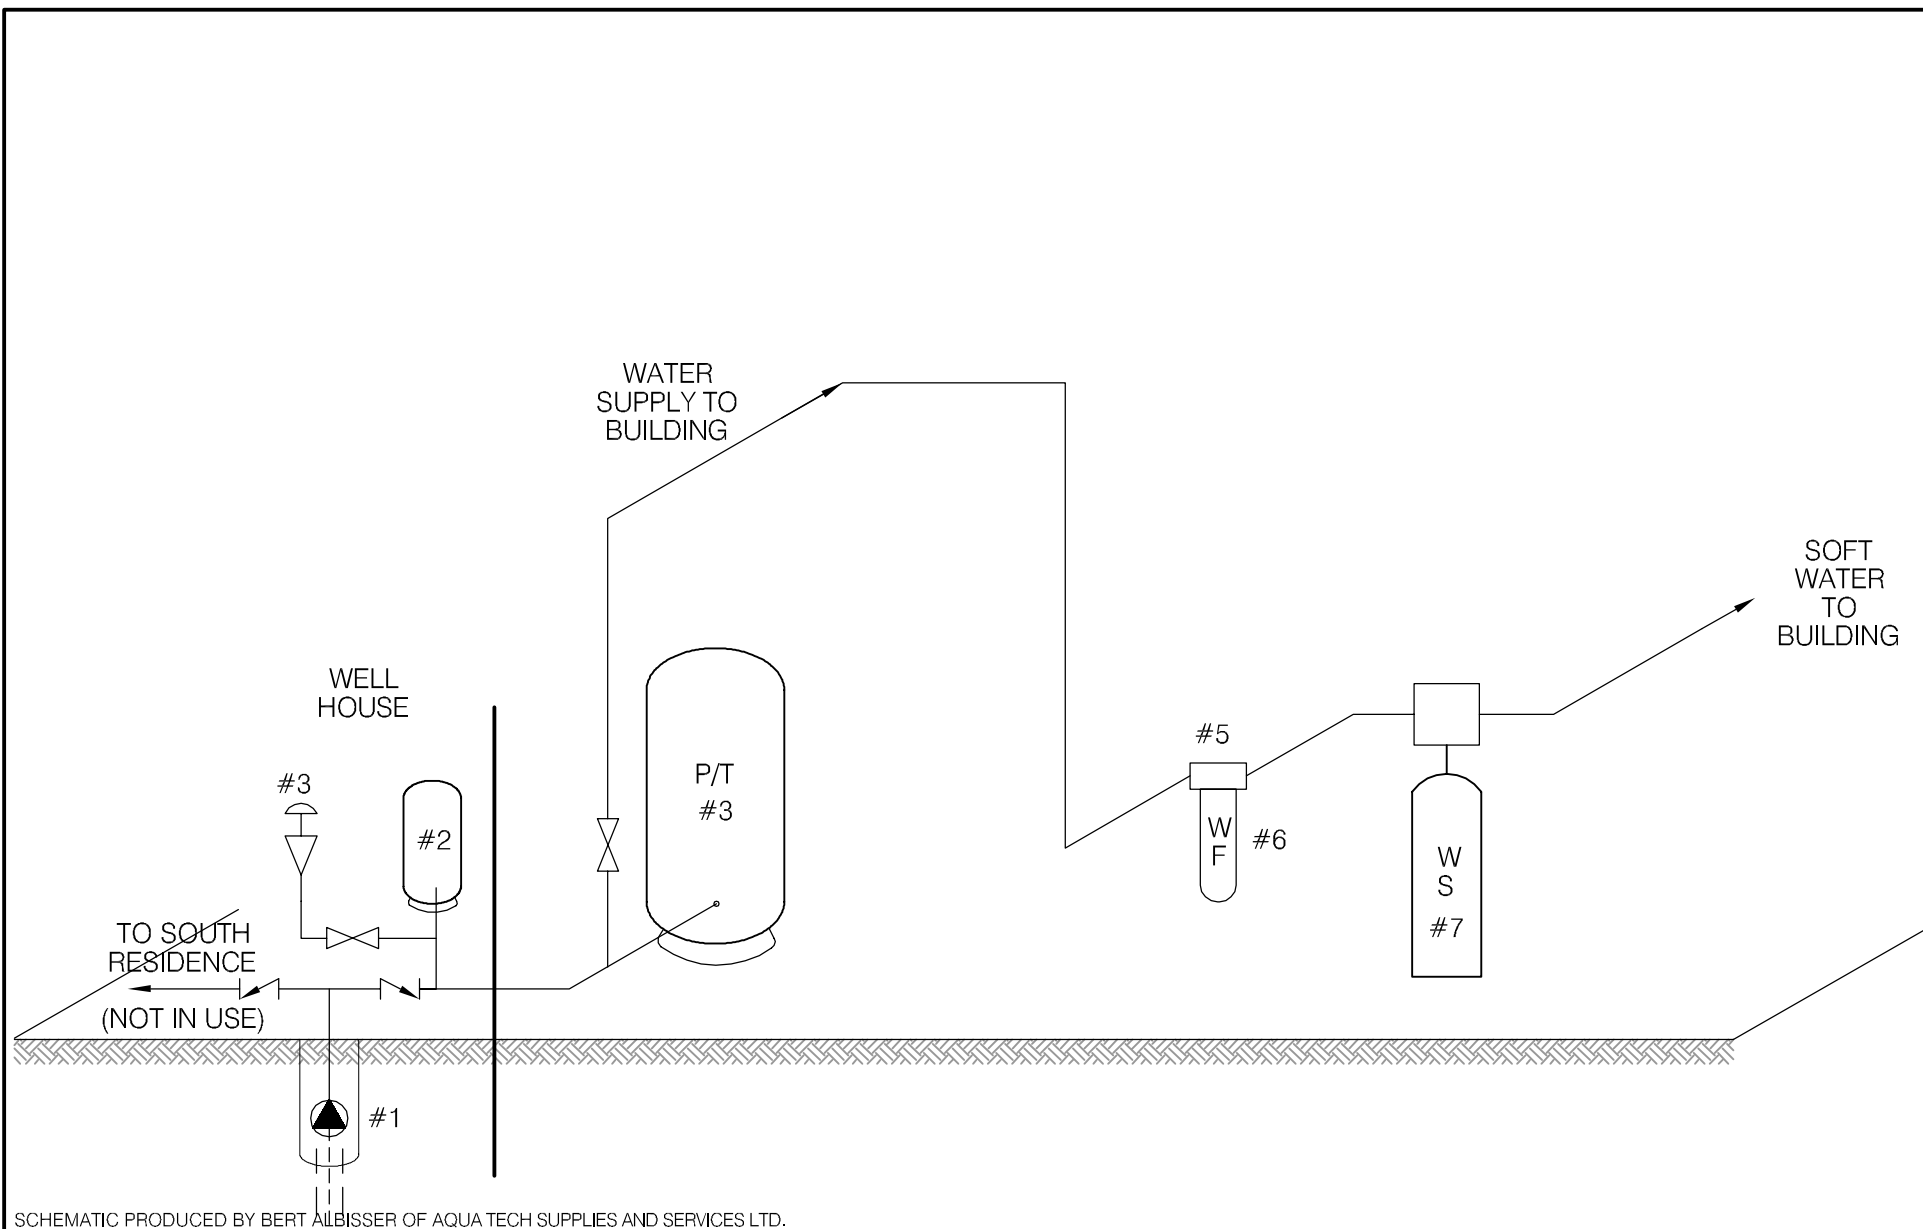

 EBA Engineering Consultants Ltd.			PROJECT SMALL PUBLIC WATER SYSTEMS ASSESSMENT WESTERN REGION		
CLIENT			TITLE		
 Highways and Public Works Property Management Branch			SCHEMATIC SYSTEM LEGEND		
DATE APRIL 2006	DWN. JSB	CHKD. RMM	FILE NO. 1260002	DRWG. LEGEND	



 EBA Engineering Consultants Ltd.			PROJECT SMALL PUBLIC WATER SYSTEMS ASSESSMENT WESTERN REGION		
CLIENT  Yukon Highways and Public Works Property Management Branch			TITLE WATER SYSTEM DISTRIBUTION/TREATMENT SCHEMATIC SYSTEM ID.: M0133 BEAVER CREEK RCMP RESIDENCE		
DATE	SEPT. 2005	DWN.	JSB	CHKD.	RMM
FILE NO.	1260002.003	DWG.:	FIGURE M0133-B		

Western Region – R.C.M.P. Housing
Building # MO133 ? North

DISTRIBUTION & TREATMENT SYSTEM DATA

Item	Description	Manufacturer	Model	Part No.	Serial No.	Size
1	SUB. Pump	UNKNOWN	3/4 HP.			4" - 3/4 HP
2	PRESSURE TANK #1	JET RITE	JR 15.			
3	PRESSURE TANK #2	WELL RITE	WR-260			
4	PRESSURE SWITCH	SQARE D	FSG-2			2HP - 1/4" NPT.
5	INLINE FILTER	CUNO	10" CLEAR			10" 3/4" NPT
6	FILTER CART.	CUNO	AP-110			10" x 2 1/2"
7	WATER SOFTENER	NOVATEK.	HCZOMI		202531	20K.
8						
9						
10						

TABLE MO133- 1: SUMMARY OF BACTERIOLOGICAL RESULTS

		Number of Sampling Events	Time Period over which Sampling was Done	Any Positive Total Coliform Results? (yes or no)	Fraction of Positive Total Coliform Results vs. Total Sampling Events	Any positive E.Coli results? (yes or no)	Most Recent Sampling Event Available for EBA Review	Is Most Recent Result Positive?
Building #	Building Name							
M0133	Beaver Creek R.C.M.P. Residence	4	Sept-04 to Jun-05	no	0/4	no	16-Jun-05	no



Table MO133-2: Water Quality Results

SOURCE:		Building M0133 - Beaver Creek RCMP Residence			GCDWQ Criteria		
Location/ Resident		Beaver Creek					
Address							
Treatment		Filtration					
Disinfection		None					
Source of Water		On-site well					
Purpose of Sampling		Base Line	Base Line	Additional Analytical			
Sample Location				Kitchen tap			
Date Sampled		23-Sep-04	15-Jun-05	27-Jul-05	Lower	Upper Limit	
Physical Tests (ALS)					AO	MAC	AO
Colour (CU)		<5	<5.0	-			15
Conductivity (uS/cm)			309	-			
Total Dissolved Solids		171	189	-			500
Hardness CaCO3		151	141	-	AO >200 = poor, > 500 unacceptable		
pH		8.21	8.25	-	6.5		8.5
Turbidity (NTU)		0.4	2.28	0.360		1	5
UV Absorbance				0.0050			
% UV Transmittance				98.9			
Dissolved Anions (ALS)							
Alkalinity-Total CaCO3		128	138	-			
Chloride Cl		1.1	0.83	-			250
Fluoride F		<0.05	0.057	-		1.5	
Silicate SiO4				-			
Sulphate SO4		32.6	35.2	-			500
Nitrate Nitrogen N		0.2	0.22	-		10	
Nitrite Nitrogen N		<0.05	<0.10	-		3.2	
Ammonia Nitrogen N				-			
Total Phosphate PO4				-			
Total Metals (ALS)							
Aluminum T-Al		<0.005	<0.010	-			
Antimony T-Sb		<0.0002	<0.00050	-		0.006	
Arsenic T-As		0.0012	0.00093	-		0.025	
Barium T-Ba		0.017	<0.020	-		1	
Boron T-B		0.027	<0.10	-		5	
Cadmium T-Cd		<0.00001	<0.00020	-		0.005	
Calcium T-Ca			45.2	-			
Chromium T-Cr		0.0006	<0.0020	-		0.05	
Copper T-Cu		0.053	0.0494	-		1	
Iron T-Fe		0.03	<0.030	-			0.3
Lead T-Pb		<0.0001	<0.0010	-		0.01	
Magnesium T-Mg			6.86	-			
Manganese T-Mn		<0.005	<0.0020	-			0.05
Mercury T-Hg			<0.00020	-		0.001	
Potassium T-K			1.24	-			
Selenium T-Se			<0.0010	-		0.01	
Sodium T-Na			2.8	-			200
Uranium T-U		<0.0005	0.00035	-		0.02	
Vanadium T-V				-			
Zinc T-Zn		0.021	<0.050	-			5
Organic Parameters							
Tannin and Lignin				<0.10			
Total Organic Carbon C				1.03			
Field Chemistry (EBA)							
pH				8.34	6.5		8.5
TDS (ppm)				51			500
EC (uS/cm)				104			
Temperature (°C)				7.8			
Free Available Chlorine							

Notes:

A. Guidelines indicated for hardness are not CDWQG, rather they are general aesthetic guidelines

- exceedences are indicated in yellow highlighting.

Italics and underline indicates exceedence of proposed MAC (ie. arsenic)**Bold with Yellow** highlighting indicates exceedence of CDWQG Aesthetic Objective (AO)**Bold Underline with Yellow** highlighting indicates exceedence of CDWQG MAC

Results are expressed as milligrams per litre except for pH and Colour (CU)

Conductivity (umhos/cm), Temperature (°C) and Turbidity (NTU)

< = Less than the detection limit indicated.

AO = Aesthetic Objective

MAC = Maximum Acceptable Concentration (Health Based)



EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

SMALL PUBLIC WATER SYSTEM ASSESSMENT

PART A: EBA Site Inspection

Inspector: Ryan Martin, Luke Lebel

Date July 27, 2009

WELL ID #	Owner	Location Description
M0133	RCMP	Beaver Creek RCMP Residences

1. Well Location and Potential Contaminant Sources

a. General location of well: (Community, Subdivision, etc.)

Beaver Creek

b. Specific location: (Road or street, Building number, name of owner and/, legal description,

c. GPS location: N 6917199 E 506150 elv 667m \pm 6m

d. Is there electric power? ☒ Yes ☐ No

e. Is there outside water access? ☒ Yes ☐ No

f. Does the well system have:

☐ 15 or more service connections to a piped distribution system? If so how many RCMP Residence.

☐ 5 or more delivery sites on a trucked distribution system? If so how many

g. Nearest building, specify located off of basement of M0133 Residence

h. Distance from well to building

i. If there is an effluent disposal field, is its location known? ☒ Yes ☐ No

j. Distance from well to nearest point of known field: ~20m to tank, ~40m to field

k. Well location relative to field: ☐ upslope ☒ downslope ☐ lateral

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

l. Is there any part of a sewage disposal system(s) or other potential sources of pollution that may pose a health and safety risk within 30 m? ☒ Yes ☐ No

m. Is the well located within 300 m from a sewage lagoon or pit? ☐ Yes ☒ No unlikely

n. Is the well located within 120 m from a solid waste site or dump, cemetery? ☐ Yes ☒ No unlikely

o. Is the infrastructure protecting the wellhead, pumphouse, storage tank and/or water treatment plant designed and secured to prevent:

Unauthorized access by humans? ☒ Yes ☐ No Entrance by animals? ☐ Yes ☒ No
located in residence

p. Is well site subject to flooding? ☐ Yes ☒ No

q. Is the well site well drained? ☐ Yes ☒ No Ground around well is flat

r. Is there a buried fuel tank on the property? ☐ Yes ☒ No unlikely

If yes, is it ☐ in use ☐ abandoned

Is the location known? ☐ Yes ☐ No

Distance from the well to known buried tank _____

s. Are there any other known contaminant sources on the property?

☒ Yes ☐ No Describe _____

If yes, specify the source: ☐ dump ☐ sewage lagoon ☐ cemetery ☐ other

Potential Source 1: Indoor AST; Distance from well to Potential Source 1: ~2m

Potential Source 2: _____; Distance from well to Potential Source 2: _____

Potential Source 3: _____; Distance from well to Potential Source 3: _____

Potential Source 4: _____; Distance from well to Potential Source 4: _____

t. Are there other wells on this property? ☒ Yes ☒ No

How many? 1 ☐ in use ☒ abandoned ☒ require proper sealing

is not equipped with a cap on the casing

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

2. Well and Wellhead information:

- a. When was well installed? Year 1992 Month June
- b. Type: ☒ drilled ☐ dug ☐ sand point ☐ other _____
- c. Is there a drillers log for the well: ☒ Yes ☐ No
- d. Is there a surface seal to 6 m ☐ Yes ☒ No ☐ unknown ☐ unlikely
- e. Surface casing: ☐ Yes Diameter _____ ☒ No
- f. Well casing: Diameter 15 cm Material: ☒ steel ☐ plastic ☐ concrete
- g. Depth of well: 35.90 m ^{could be pump} ☒ measured (if possible) ☐ reported ☐ from log 123 ft from log
- h. Static water level below ground: 12.090 m bc 47 ft from log
☒ measured (if possible) ☐ reported ☐ from log ☐ flowing
- i. (If granular) Is the well completed: ☐ open end casing ☒ with a well screen
☐ with slotted pipe ☐ unknown other _____
- j. (If bedrock) Does the well have a liner? ☐ yes ☐ No ☐ steel ☐ plastic
- k. If there is a well screen: length _____ slot size(s) 25 slot
Location of screen: from 12.15 ft to 123 ft from log reported
- l. Is there a sump below the screen? ☐ Yes ☐ No
- m. Is the well head: ☐ in pumphouse ☐ in pit ☐ pitless adaptor ☐ in a building
☒ in a wooden enclosure other, describe of from basement of residence
- n. If the well head is located in a wooden enclosure,

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

- i. Is the well head below grade? describe in detail ~ 1.85m below grade
- ii. Are there signs of ponding on the enclosure(e.g. water stains, etc.)? ☒ Yes ☐ No
Some dampness on floor
- iii. Is the wellhead enclosed by fiberglass insulations? ☒ Yes ☐ No in walls of enclosure
- iv. Any evidence of rodents? Specify Access possible
- v. Does the well casing have a proper seal cap? ☒ Yes ☐ No
If no, describe condition Split gasket cap

3. Water Supplying This Well:

- a. By definition is the water from a surface water source or under the direct influence of surface water?
☒ Yes ☐ No ☐ farther investigation required.
- If yes is there treatment or disinfection ☒ Yes ☐ No
- Explain (filtration, disinfection etc...) filtration

4. Aquifer Supplying This Well:

- a. The aquifer is: ☐ bedrock ☒ granular sediment ☐ unknown
- b. Does water level and/or well capacity show seasonal fluctuation? ☐ Yes ☒ No unlikely

5. Pump Installation:

- a. Is the well equipped with a pump? ☒ yes ☐ No
- b. Type of pump: ☐ hand ☒ electric submersible ☐ jet
☐ shallow well centrifugal ☐ other, _____
- c. Description: Manufacturer _____ Model _____
horsepower _____ capacity _____ voltage _____

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

d. Date installed: _____ By: _____

e. For submersible pump, depth of setting below surface _____

f. Drop pipe for submersible pump: ☐ steel ☒ plastic

g. Pump delivers water to: ☒ pressure tank ☐ elevated tank ☐ other

h. Are there automatic pump controls: ☒ Yes ☐ No

i. Is there provision for taking water samples before water reaches storage? ☐ Yes ☒ No

j. Is there a water meter on the system? ☐ Yes ☒ No

k. Is the pump and piping protected from freezing? ☒ Yes ☐ No

If yes, describe: OFF from heated building

l. Comments on pump installation: _____

6. Conclusions

a. Comments on overall installation:

b.Recommendations: _____

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

PART B: EBA Site Inspection

Inspector: BEET ALBISER

Date July 27/05

WELL ID #	Owner	Location Description
MO133	YTG	RAMP RESIDENCE (NORTH) BEVER CREEK

6. Water Treatment

- a. Is well water treated? ☒ Yes ☐ No; Type of treatment: WATER SOFTENER
- ☐ chlorination ☒ iron and or manganese removal ☐ other _____
- b. Is water entering plumbing or piped distribution system treated with chlorine or another treatment that is as effective as chlorine used to achieve disinfection throughout the system?
- ☐ Yes ☒ No If so how _____
- c. If treated with chlorine, is the free residual chlorine concentration less than 0.2 mg/L
- ☐ Yes ☒ No _____ reading.
- Tested at _____ (location)
- d. Is testing for chlorine residual concentration done at the tap (eg. Kitchen faucet) or from representative points in a piped distribution system, including a point from tap at the end line
- ☐ Yes ☒ No If yes how often? _____
- e. If the drinking water is being transported by water delivery truck does it have a minimum chlorine free residual of 0.4 mg/L at the time of fill. ☐ Yes ☒ No

7. Water Quality (observations):

- a. Does the water stain plumbing? ☒ yes ☐ No ☒ slight ☐ severe
- Type of stain: ☐ brown ☒ red ☐ black
- b. Does the water contain sediment? ☐ Yes ☒ No ☐ occasional ☐ constant
- c. Is there an unpleasant odour? ☐ Yes ☒ No ☐ H₂S ☐ Other _____

EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

- d. Is there an unpleasant taste? ☐ Yes ☒ No ☐ brackish ☐ Other _____
- e. Is there a history of bad bacterial analyses? ☐ Yes ☐ No ?
- f. Is there a chemical analysis? ? ☐ Yes ☐ No ☐ adequate ☐ incomplete
- g. Is there analysis of trihalomethanes (THMs) where the water source is a surface water supply or a well under the direct influence of surface water? ☐ Yes ☒ No
- h. Is the drinking water tested daily with an accurate reading chlorine test kit capable of reading in the range 0 to 3.5 mg/L of free chlorine residual in increments of 0.1mg/L? ☐ Yes ☒ No ☐ unknown
- i. If yes is the test performed in accordance with manufactures directions? ☐ Yes ☒ No ☐ unknown
- j. Is a record of the date, time, name of person performing the test and results of the drinking water sample kept? ☐ Yes ☒ No

TANK AND PIPING DETAILS

Tank Room

Is there a water tank? ☒ Yes No Details: PRESSURE TANK.

Where is it located?

Comments: # 1 IN WELL ENCLOSE / # 2 IN BASEMENT

Is the room in which the water tank is located heated to maintain an optimum temperature of 4°C for stored water?

☒ YES ☐ NO

Comments: _____

Are there windows in the add-on that may allow direct sunlight onto the water holding tank? YES

NO

Comments: _____

Are there other heat sources near the tank? YES NO

Comments: _____

Is there waterproof flooring with a sealed base to contain spills? YES NO

Comments: _____

Overall Tank

What are the tank size and dimensions?

What material is the tank constructed of? _____

Is tank and associated piping constructed of safe materials (i.e. CSA approved and material that does not affect the taste of the water)? YES NO

Comments: _____

Tank Inlet, Outlet and Lid

Is there adequate access on the tank for cleaning (i.e. min 15" access lid)? YES NO

Does the lid have a tight seal and is it watertight when closed? YES NO

Does the tank have an overflow or high level whistle? YES NO

Is the water tank drain accessible? YES NO

WATER TANK AND WATER QUALITY CONDITION

Are there signs of staining or biofouling? YES NO

Comments: _____

Is there any sediment or scum in bottom of tank? YES NO

Comments: _____

Is there any odour associated with the water or tank? YES NO

Have there been any bacteriological analyses conducted previously? YES NO

Does the tank appear that it has been cleaned recently? YES NO

Are the tanks easily assessed for the purpose of cleaning and disinfection? YES NO

8. Conclusions

a. Comments on overall installation:

THE PIPING AT WELL HEAD IS UNPROFESSIONAL.
THE WATER SOFTENER IS NOT OPERATIONAL
AND THE INLINE FILTER IS IN NEED OF
CHANGING.
THE SOFTENER DRAIN IS NOT TO CODE.

b. Recommendations:

REPAIR WATER SOFTENER AS NECESSARY IN
PUT BACK INTO SERVICE. CHANGE INLINE
FILTER. REPIPE SOFTENER DRAIN TO CODE.
BRING WELL HEAD PIPING TO CODE.

interns



Photo 0545: M0133 Beaver Creek RCMP Residence from rear, wellhead enclosure (front centre)



Photo 0544: M0133 Septic field



Photo 0089: M0133 Pressure tank



Photo 0090: M0133 In-line filter and water softener