


1. UTM COORDINATES OBTAINED WITH A HAND HELD GPS USING NAD83 SYSTEM AND ARE CONSIDERED TO BE ACCURATE TO 10.0 m, APPROXIMATELY.

[illegible]


**EBA Engineering**

---

DESIGNED BY: \_\_\_\_\_ R. MARTIN  
 DRAWN BY: \_\_\_\_\_ J. BUICK  
 DATE: \_\_\_\_\_ AUG. 2005  
 SCALE: \_\_\_\_\_ AS SHOWN  
 PROJECT No.: \_\_\_\_\_ 1200002.003  
 ACO FLEETWERK: \_\_\_\_\_ 003-WESTERN REGION

**Engineering Consultants Ltd.**


CLIENT:

**Yukon**

Highways and Public Works  
Property Management Branch

SMALL PUBLIC WATER SYSTEMS ASSESSMENT WESTERN REGION	
GOVERNMENT OF YUKON HIGHWAYS & PUBLIC WORKS	
BEAVER CREEK RCMP RESIDENCE BUILDING # M0134 SITE LOCATION DIAGRAM WELL ID: M0134	REVISION ISSUE 0
FIGURE NO. FIGURE M0134-A	

## LEGEND

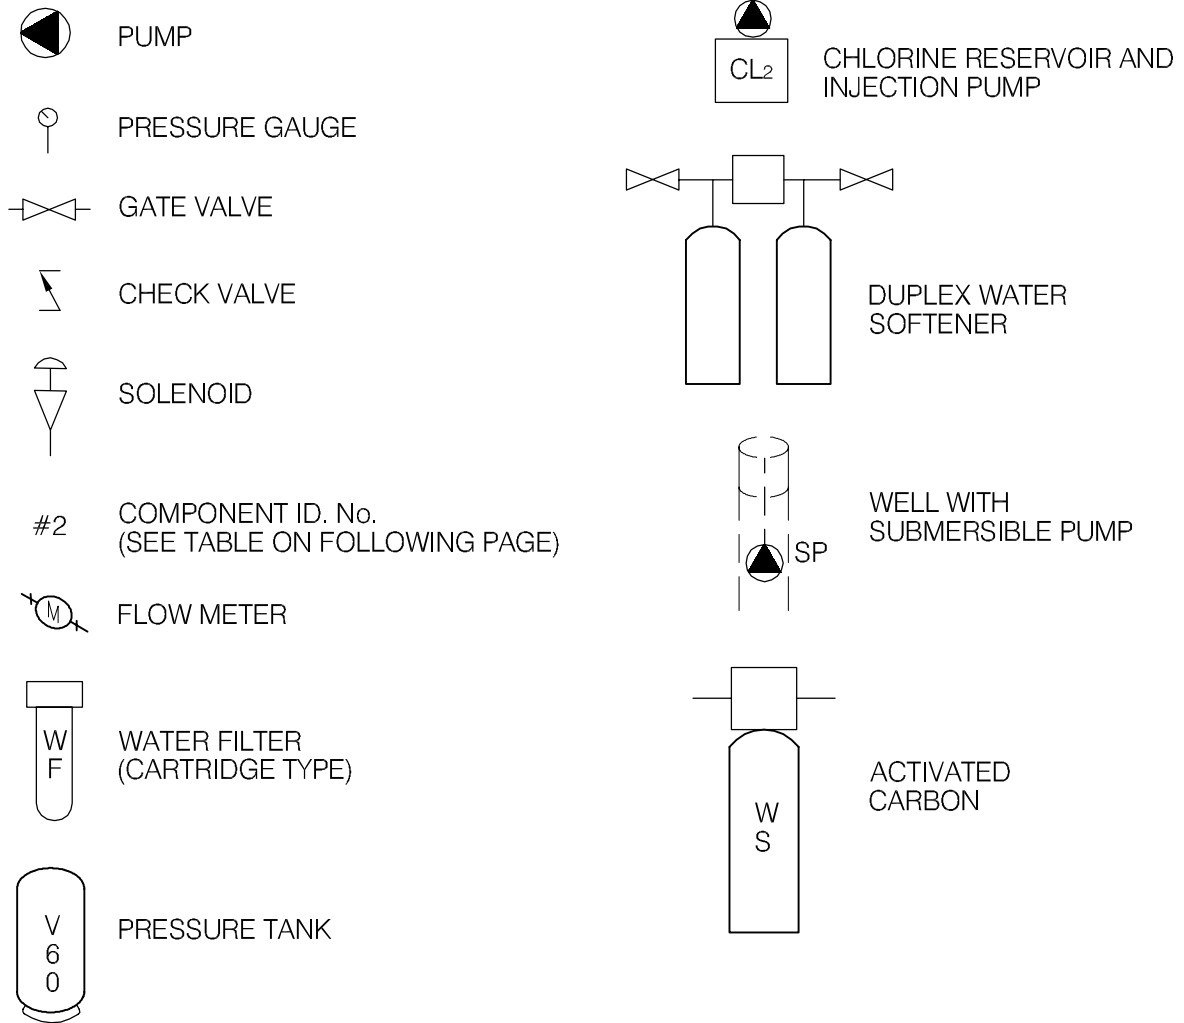

**EBA Engineering Consultants Ltd.**

CLIENT

**Yukon**  
Highways and Public Works  
Property Management Branch

PROJECT

SMALL PUBLIC WATER SYSTEMS ASSESSMENT  
WESTERN REGION

TITLE

SCHEMATIC SYSTEM  
LEGEND


DATE    APRIL 2006

DWN.    JSB

CHKD.    RMM

FILE NO.            1260002

DRWG.            LEGEND

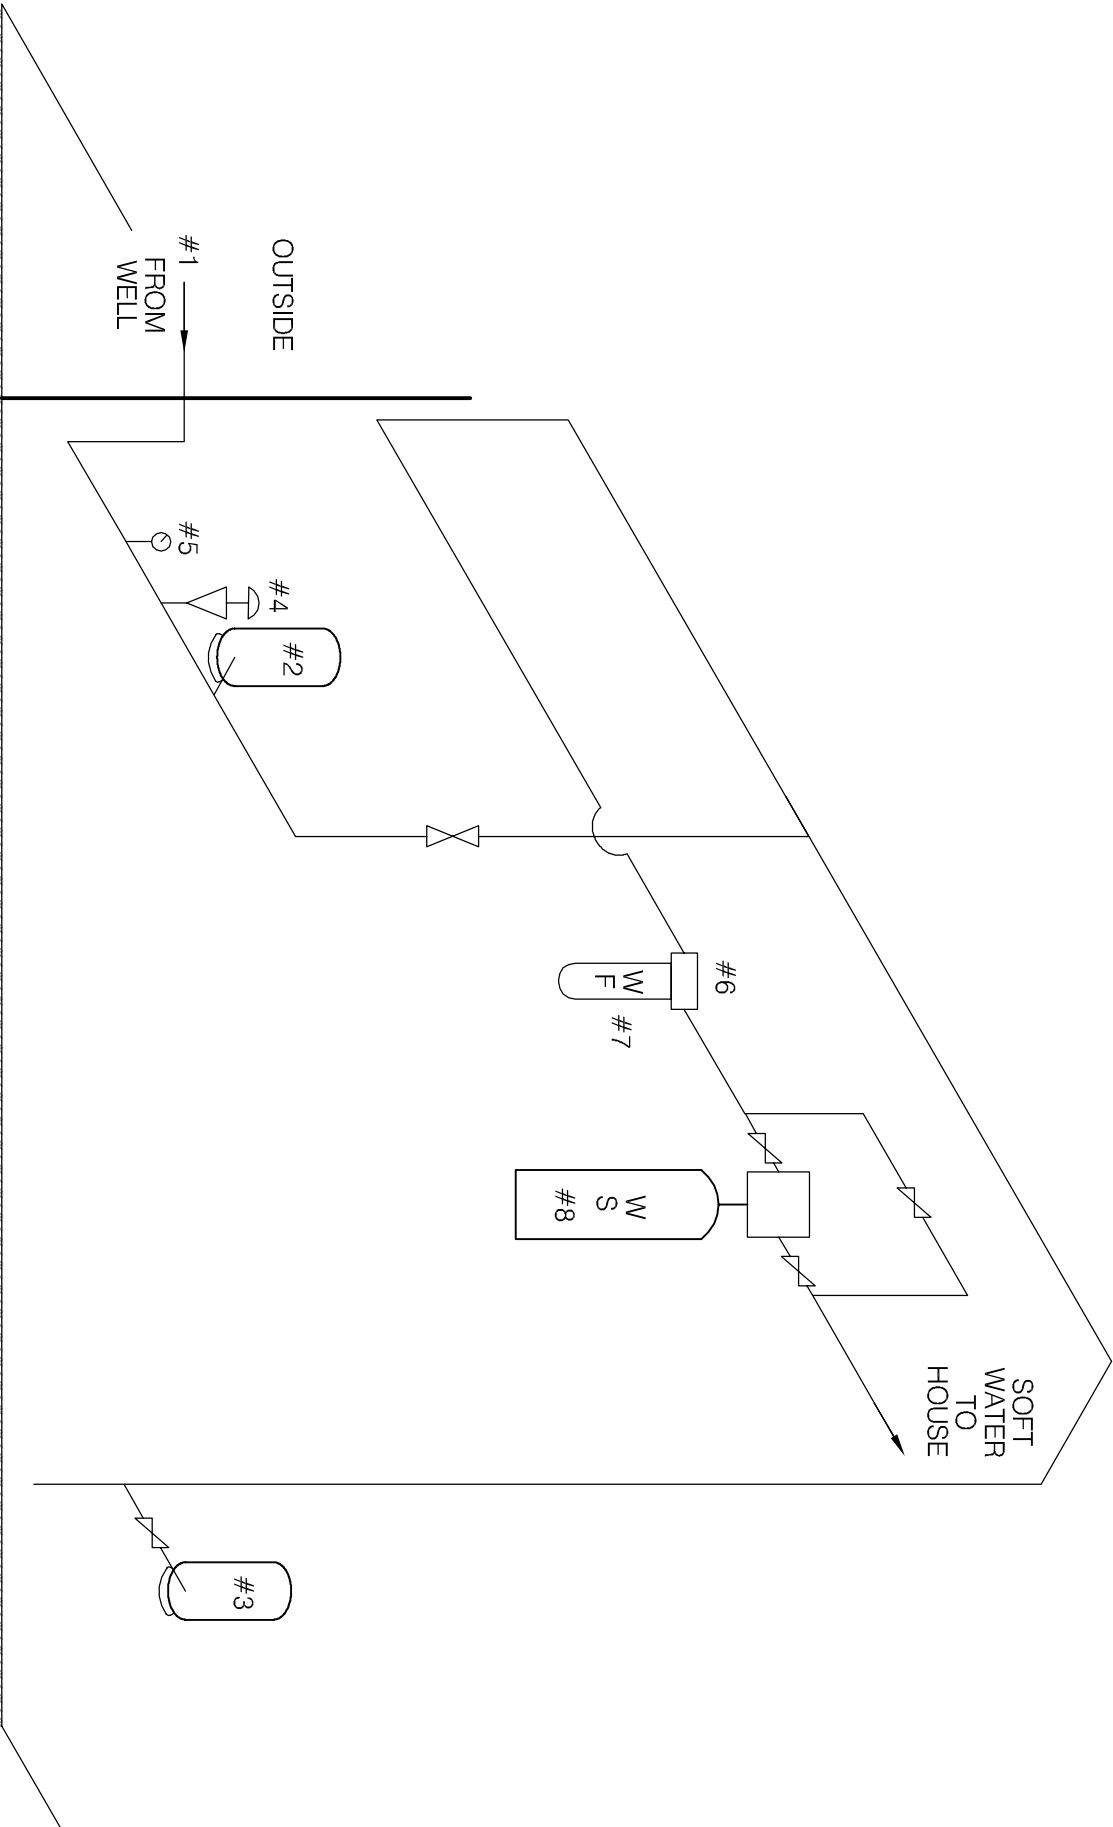

SCHEMATIC PRODUCED BY BERT ALBISSER OF AQUATECH SUPPLIES AND SERVICES LTD.



**EBA Engineering Consultants Ltd.**

CLIENT



Highways and Public Works  
Property Management Branch

PROJECT

SMALL PUBLIC WATER SYSTEMS ASSESSMENT  
WESTERN REGION

TITLE

WATER SYSTEM DISTRIBUTION/TREATMENT  
SCHEMATIC SYSTEM ID.: M0134  
BEAVER CREEK RCMP RESIDENCE

DATE

SEPT. 2005

DWN.

JSB

CHKD.

FMN

FILE NO.

1260002.003

DWG.:

FIGURE M0134-B

Western Region – R.C.M.P. Housing  
Building # MO134

DISTRIBUTION & TREATMENT SYSTEM DATA

Item	Description	Manufacturer	Model	Part No.	Serial No.	Size
1	SUB PUMP	Goulds	7G505-412L		C7712242	4" - 1/2 HP
2	PRESSURE TANK #1	Goulds	1/60		GG9914	
3	PRESSURE TANK #2	Werner Rite	NR-260			
4	PRESSURE SWITCH	Square D	FSG-2			2HP 1/4" NPT
5	PRESSURE GAUGE	Marsh	2"-(0-100 PSI)			2" 1/4" NPT
6	INLINE FILTER	Cuno	10" CLARE			
7	INLINE CART	Cuno	10"-AP110			
8	WATER SOFTENER	NOVATEK	HC2041		202531	20K.
9						
10						

TABLE MO134- 1: SUMMARY OF BACTERIOLOGICAL RESULTS

Building #	Building Name	Number of Sampling Events	Time Period over which Sampling was Done	Any Positive Total Coliform Results? (yes or no)	Fraction of Positive Total Coliform Results vs. Total Sampling Events	Any positive E. Coli results? (yes or no)	Most Recent Sampling Event Available for EBA Review	Is Most Recent Result Positive?
MO134	Beaver Creek R.C.M.P. Residence	4	Sept-04 to Jun-05	no	0/4	no	16-Jun-05	no



Table M0134-2: Water Quality Results

SOURCE:		Building M0134 - Beaver Creek RCMP Residence			GCDWQ Criteria		
Location/ Resident		Beaver Creek					
Address							
Treatment		None					
Disinfection		None					
Source of Water		On-site well					
Purpose of Sampling		Base Line	Base Line	Additional Analytical			
Sample Location				Kitchen tap			
Date Sampled		23-Sep-04	15-Jun-05	27-Jul-05	Lower	Upper Limit	
Physical Tests (ALS)					AO	MAC	AO
Colour (CU)		<5	<5.0	-			15
Conductivity (uS/cm)			310	-			
Total Dissolved Solids		164	188	-			500
Hardness CaCO3		149	140	-	AO >200 = poor, > 500 unacceptable <sup>A</sup>		
pH		8.21	8.24	-	6.5		8.5
Turbidity (NTU)		0.5	0.84	-		1	5
UV Absorbance				0.0080			
% UV Transmittance				98.2			
Dissolved Anions (ALS)							
Alkalinity-Total CaCO3		119	131	-			
Chloride Cl		<0.5	1.08	-			250
Fluoride F		<0.05	0.06	-		1.5	
Silicate SiO4				-			
Sulphate SO4		32.6	35.3	-			500
Nitrate Nitrogen N		0.2	0.22	-		10	
Nitrite Nitrogen N		<0.05	<0.10	-		3.2	
Ammonia Nitrogen N				-			
Total Phosphate PO4				-			
Total Metals (ALS)							
Aluminum T-Al		<0.005	<0.010	-			
Antimony T-Sb		<0.0002	<0.00050	-		0.006	
Arsenic T-As		0.0011	0.00095	-		0.025	
Barium T-Ba		0.017	<0.020	-		1	
Boron T-B		0.026	<0.10	-		5	
Cadmium T-Cd		<0.00001	<0.00020	-		0.005	
Calcium T-Ca			44.9	-			
Chromium T-Cr		0.0007	<0.0020	-		0.05	
Copper T-Cu		0.153	0.139	-		1	
Iron T-Fe		0.03	<0.030	-			0.3
Lead T-Pb		<0.0001	<0.0010	-		0.01	
Magnesium T-Mg			6.8	-			
Manganese T-Mn		<0.005	<0.0020	-			0.05
Mercury T-Hg			<0.00020	-		0.001	
Potassium T-K			1.25	-			
Selenium T-Se			<0.0010	-		0.01	
Sodium T-Na			2.7	-			200
Uranium T-U		<0.0005	0.00035	-		0.02	
Vanadium T-V				-			
Zinc T-Zn		0.003	<0.050	-			5
Organic Parameters							
Tannin and Lignin				<0.10			
Total Organic Carbon C				0.72			
Field Chemistry (EBA)							
pH				8.31	6.5		8.5
TDS (ppm)				149			500
EC (uS/cm)				308			
Temperature (°C)				9.6			
Free Available Chlorine							

**Notes:**

A. Guidelines indicated for hardness are not CDWQG, rather they are general aesthetic guidelines

- exceedences are indicated in yellow highlighting.

*Italics* and underline indicates exceedence of proposed MAC (ie. arsenic)**Bold with Yellow** highlighting indicates exceedence of CDWQG Aesthetic Objective (AO)**Bold Underline with Yellow** highlighting indicates exceedence of CDWQG MAC

Results are expressed as milligrams per litre except for pH and Colour (CU)

Conductivity (umhos/cm), Temperature (°C) and Turbidity (NTU)

&lt; = Less than the detection limit indicated.

AO = Aesthetic Objective

MAC = Maximum Acceptable Concentration (Health Based)



# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

## SMALL PUBLIC WATER SYSTEM ASSESSMENT

### PART A: EBA Site Inspection

Inspector: Ryan Martin, Luke Lebel

Date July 27, 2005

WELL ID #	Owner	Location Description
M0134	RCMP	Beaver Creek RCMP Residence (South)

#### 1. Well Location and Potential Contaminant Sources

a. General location of well: (Community, Subdivision, etc.)

Beaver Creek

b. Specific location: (Road or street, Building number, name of owner and/, legal description,

c. GPS location: N 6917131 E 506146 elv 669m ±6m

d. Is there electric power? ☒ Yes ☐ No

e. Is there outside water access? ☒ Yes ☐ No

f. Does the well system have:

☐ 15 or more service connections to a piped distribution system? If so how many \_\_\_\_\_  
RCMP Residence

☐ 5 or more delivery sites on a trucked distribution system? If so how many \_\_\_\_\_

g. Nearest building, specify RCMP Residence

h. Distance from well to building ~ 3 m

i. If there is an effluent disposal field, is its location known? ☒ Yes ☐ No

j. Distance from well to nearest point of known field: ~28m to tank, ~37m to field

k. Well location relative to field: ☐ upslope ☒ downslope ☐ lateral

# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

l. Is there any part of a sewage disposal system(s) or other potential sources of pollution that may pose a health and safety risk within 30 m? ☒ Yes ☐ No

m. Is the well located within 300 m from a sewage lagoon or pit? ☐ Yes ☒ No unlikely

n. Is the well located within 120 m from a solid waste site or dump, cemetery? ☐ Yes ☒ No unlikely

o. Is the infrastructure protecting the wellhead, pumphouse, storage tank and/or water treatment plant designed and secured to prevent:

Unauthorized access by humans? ☐ Yes ☒ No  
unlocked enclosure

Entrance by animals? ☐ Yes ☒ No  
Access possible

p. Is well site subject to flooding? ☒ Yes ☐ No  
Dampness in pit

q. Is the well site well drained? ☒ Yes ☐ No

r. Is there a buried fuel tank on the property? ☐ Yes ☒ No unlikely

If yes, is it ☐ in use ☐ abandoned

Is the location known? ☐ Yes ☐ No

Distance from the well to known buried tank \_\_\_\_\_

s. Are there any other known contaminant sources on the property?

☒ Yes ☐ No Describe \_\_\_\_\_

If yes, specify the source: ☐ dump ☐ sewage lagoon ☐ cemetery ☐ other

Potential Source 1: Indoor AST; Distance from well to Potential Source 1: \_\_\_\_\_

Potential Source 2: \_\_\_\_\_; Distance from well to Potential Source 2: \_\_\_\_\_

Potential Source 3: \_\_\_\_\_; Distance from well to Potential Source 3: \_\_\_\_\_

Potential Source 4: \_\_\_\_\_; Distance from well to Potential Source 4: \_\_\_\_\_

t. Are there other wells on this property? ☐ Yes ☒ No

How many? \_\_\_\_\_ ☐ in use ☐ abandoned ☐ require proper sealing



# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

## 2. Well and Wellhead information:

- a. When was well installed? Year unknown - within the last 5 years Month \_\_\_\_\_
- b. Type: ☒ drilled ☐ dug ☐ sand point ☐ other \_\_\_\_\_
- c. Is there a drillers log for the well: ☐ Yes ☒ No
- d. Is there a surface seal to 6 m ☐ Yes ☒ No ☐ unknown ☒ unlikely
- e. Surface casing: ☐ Yes Diameter \_\_\_\_\_ ☒ No
- f. Well casing: Diameter 15cm Material: ☒ steel ☐ plastic ☐ concrete
- g. Depth of well: unknown ☐ measured (if possible) ☐ reported ☐ from log
- h. Static water level below ground: unknown  
☐ measured (if possible) ☐ reported ☐ from log ☐ flowing
- i. (If granular) Is the well completed: ☐ open end casing ☐ with a well screen  
☐ with slotted pipe ☒ unknown other \_\_\_\_\_
- j. (If bedrock) Does the well have a liner? ☐ yes ☐ No ☐ steel ☐ plastic
- k. If there is a well screen: length unknown slot size(s) \_\_\_\_\_  
Location of screen: from \_\_\_\_\_ to \_\_\_\_\_ from log reported
- l. Is there a sump below the screen? ☐ Yes ☒ No unlikely
- m. Is the well head: ☐ in pumphouse ☒ in pit ☐ pitless adaptor ☐ in a building  
☒ in a wooden enclosure other, describe \_\_\_\_\_
- n. If the well head is located in a wooden enclosure,

# **EBA Engineering Consultants Ltd.**

Creating and Delivering Better Solutions

- i. Is the well head below grade? describe in detail ~ 1.05 m below grade
- ii. Are there signs of ponding on the enclosure(e.g. water stains, etc.)? ☒ Yes ☐ No
- iii. Is the wellhead enclosed by fiberglass insulations? ☒ Yes ☐ No
- iv. Any evidence of rodents? Specify Yes,
- v. Does the well casing have a proper seal cap? ☒ Yes ☐ No
- If no, describe condition split gasket cap

## **3. Water Supplying This Well:**

- a. By definition is the water from a surface water source or under the direct influence of surface water?
- ☒ Yes ☐ No ☐ farther investigation required.

If yes is there treatment or disinfection ☐ Yes ☐ No

Explain (filtration, disinfection etc...) \_\_\_\_\_

## **4. Aquifer Supplying This Well:**

- a. The aquifer is: ☐ bedrock ☒ granular sediment ☐ unknown  
*likely*
- b. Does water level and/or well capacity show seasonal fluctuation? ☐ Yes ☒ No  
*unlikely*

## **5. Pump Installation:**

- a. Is the well equipped with a pump? ☒ yes ☐ No
- b. Type of pump: ☐ hand ☒ electric submersible ☐ jet
- ☐ shallow well centrifugal ☐ other, \_\_\_\_\_
- c. Description: Manufacturer \_\_\_\_\_ Model \_\_\_\_\_
- horsepower \_\_\_\_\_ capacity \_\_\_\_\_ voltage \_\_\_\_\_

# **EBA Engineering Consultants Ltd.**

Creating and Delivering Better Solutions

d. Date installed: \_\_\_\_\_ By: \_\_\_\_\_

e. For submersible pump, depth of setting below surface \_\_\_\_\_

f. Drop pipe for submersible pump: ☐ steel ☒ plastic

g. Pump delivers water to: ☒ pressure tank ☐ elevated tank ☐ other

h. Are there automatic pump controls: ☒ Yes ☐ No

i. Is there provision for taking water samples before water reaches storage? ☐ Yes ☒ No

j. Is there a water meter on the system? ☐ Yes ☒ No

k. Is the pump and piping protected from freezing? ☒ Yes ☐ No

If yes, describe: Insulation and heat trace

l. Comments on pump installation: \_\_\_\_\_

## **6. Conclusions**

a. Comments on overall installation:

---

---

---

---

---

---

---

b. Recommendations: \_\_\_\_\_

---

---

---

---

---

---

---

# EBA Engineering Consultants Ltd.

Creating and Delivering Better Solutions

## PART B: EBA Site Inspection

Inspector: BERT ALBISSER

Date JULY 27/05

WELL ID #	Owner	Location Description
<u>M0134</u>	<u>YTG</u>	<u>RAMP RES BEAVER CREEK</u>

### 6. Water Treatment

a. Is well water treated? ☒ Yes ☐ No; Type of treatment: WATER SOFTENER

☐ chlorination ☐ iron and or manganese removal ☐ other \_\_\_\_\_

b. Is water entering plumbing or piped distribution system treated with chlorine or another treatment that is as effective as chlorine used to achieve disinfection throughout the system?

☐ Yes ☒ No If so how \_\_\_\_\_

c. If treated with chlorine, is the free residual chlorine concentration less than 0.2 mg/L

☐ Yes ☒ No \_\_\_\_\_ reading.

Tested at \_\_\_\_\_ (location)

d. Is testing for chlorine residual concentration done at the tap (eg. Kitchen faucet) or from representative points in a piped distribution system, including a point from tap at the end line

☐ Yes ☒ No If yes how often? \_\_\_\_\_

e. If the drinking water is being transported by water delivery truck does it have a minimum chlorine free residual of 0.4 mg/L at the time of fill. ☐ Yes ☒ No

### 7. Water Quality (observations):

a. Does the water stain plumbing? ☐ yes ☐ No ☒ slight ☐ severe

Type of stain: ☐ brown ☒ red ☐ black

b. Does the water contain sediment? ☐ Yes ☒ No ☐ occasional ☐ constant

c. Is there an unpleasant odour? ☐ Yes ☒ No ☐ H<sub>2</sub>S ☐ Other \_\_\_\_\_

# **EBA Engineering Consultants Ltd.**

Creating and Delivering Better Solutions

- d. Is there an unpleasant taste? ☐ Yes ☒ No ☐ brackish ☐ Other \_\_\_\_\_
- e. Is there a history of bad bacterial analyses? ☐ Yes ☒ No
- f. Is there a chemical analysis? ☐ Yes ☒ No ☐ adequate ☐ incomplete
- g. Is there analysis of trihalomethanes (THMs) where the water source is a surface water supply or a well under the direct influence of surface water? ☐ Yes ☒ No
- h. Is the drinking water tested daily with an accurate reading chlorine test kit capable of reading in the range 0 to 3.5 mg/L of free chlorine residual in increments of 0.1mg/L? ☐ Yes ☒ No ☐ unknown
- i. If yes is the test performed in accordance with manufactures directions? ☐ Yes ☒ No ☐ unknown
- j. Is a record of the date, time, name of person performing the test and results of the drinking water sample kept? ☐ Yes ☒ No

## **TANK AND PIPING DETAILS**

### ***Tank Room***

Is there a water tank? Yes No Details: PRESSURE TANK.

Where is it located?

Comments: BASEMENT

Is the room in which the water tank is located heated to maintain an optimum temperature of 4°C for stored water?

YES NO

Comments: \_\_\_\_\_

Are there windows in the add-on that may allow direct sunlight onto the water holding tank? YES

NO

Comments: \_\_\_\_\_

Are there other heat sources near the tank? YES NO

Comments: \_\_\_\_\_

Is there waterproof flooring with a sealed base to contain spills? YES NO

Comments: \_\_\_\_\_

## ***Overall Tank***

What are the tank size and dimensions?

\_\_\_\_\_

What material is the tank constructed of? \_\_\_\_\_

Is tank and associated piping constructed of safe materials (i.e. CSA approved and material that does not affect the taste of the water)? YES NO

Comments: \_\_\_\_\_

## ***Tank Inlet, Outlet and Lid***

Is there adequate access on the tank for cleaning (i.e. min 15" access lid)? YES NO

Does the lid have a tight seal and is it watertight when closed? YES NO

Does the tank have an overflow or high level whistle? YES NO

Is the water tank drain accessible? YES NO

## **WATER TANK AND WATER QUALITY CONDITION**

Are there signs of staining or biofouling? YES NO

Comments: \_\_\_\_\_

Is there any sediment or scum in bottom of tank? YES NO

Comments: \_\_\_\_\_

Is there any odour associated with the water or tank? YES NO

Have there been any bacteriological analyses conducted previously? YES NO

Does the tank appear that it has been cleaned recently? YES NO

Are the tanks easily assessed for the purpose of cleaning and disinfection? YES NO

**8. Conclusions**

a. Comments on overall installation:

INSIDE INSTALLATION IS OF GOOD QUALITY.  
INLINE FILTER AND WATER SOFTENER IS IN  
VERY BAD CONDITION.  
SOFTENER DRAIN NOT TO CODE.

b. Recommendations:


REPAIR SOFTENER & INLINE FILTER AS  
NECESSARY TO PROVIDE PRETREAT FOR UV  
SYSTEM. INSTALL UV SYSTEM FOR  
APPROPRIATE FLOW.  
INSTITUTE BI-ANNUAL WELL MAINTENANCE  
PROGRAM. MAINTAIN TREATMENT SYSTEM  
IN WORKING ORDER.



**Photo 0549:** M0134 Beaver Creek RCMP Residence (right), wellhead enclosure (left)



**Photo 0547:** M0134 Septic field looking east towards residence

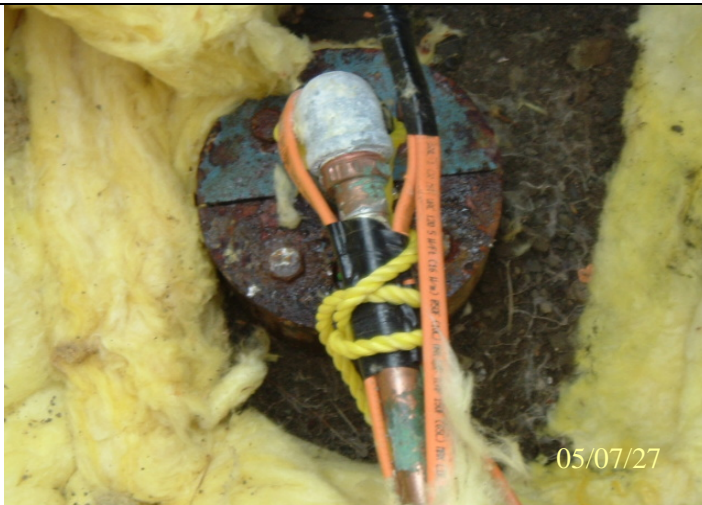

**Photo 0550:** M0134 Wellhead in pit



**Photo 0094:** M0134 pressure tank and pump controls



