


Stacked Section Map


Predicted Resistivity - 3D EPLDP

Modified Pole-Dipole Array

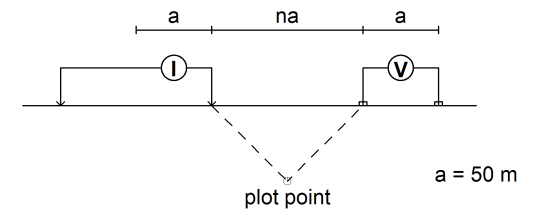


Stationary electrode at -100E (moving E).

Receiver: Iris ElrecPro
 Transmitter: GDD Tx-II 3.6kW
 Data File: NTR_3dpldp.gdb
 Dates Surveyed : July 12-13, 2012

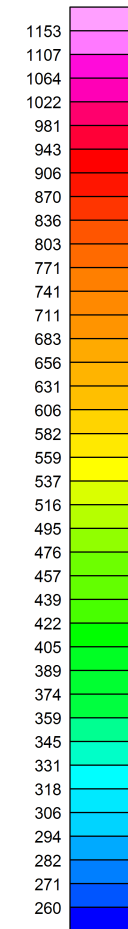


Predicted Resistivity
ohm.m


Scale 1:5000



150 N 300 E 400 E 500 E 600 E 700 E 800 E 900 E 1000 E 1100 E

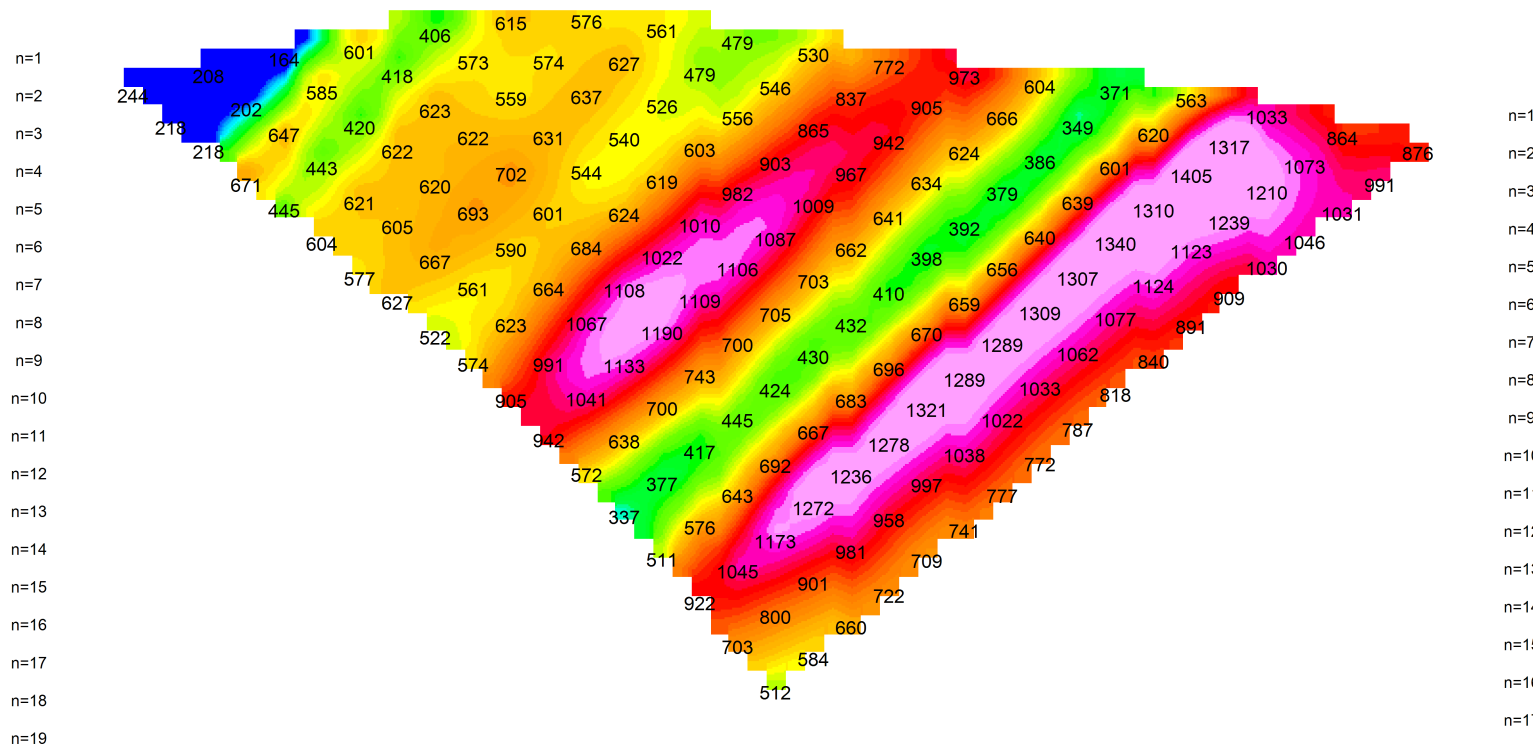

50 N 300 E 400 E 500 E 600 E 700 E 800 E 900 E 1000 E 1100 E

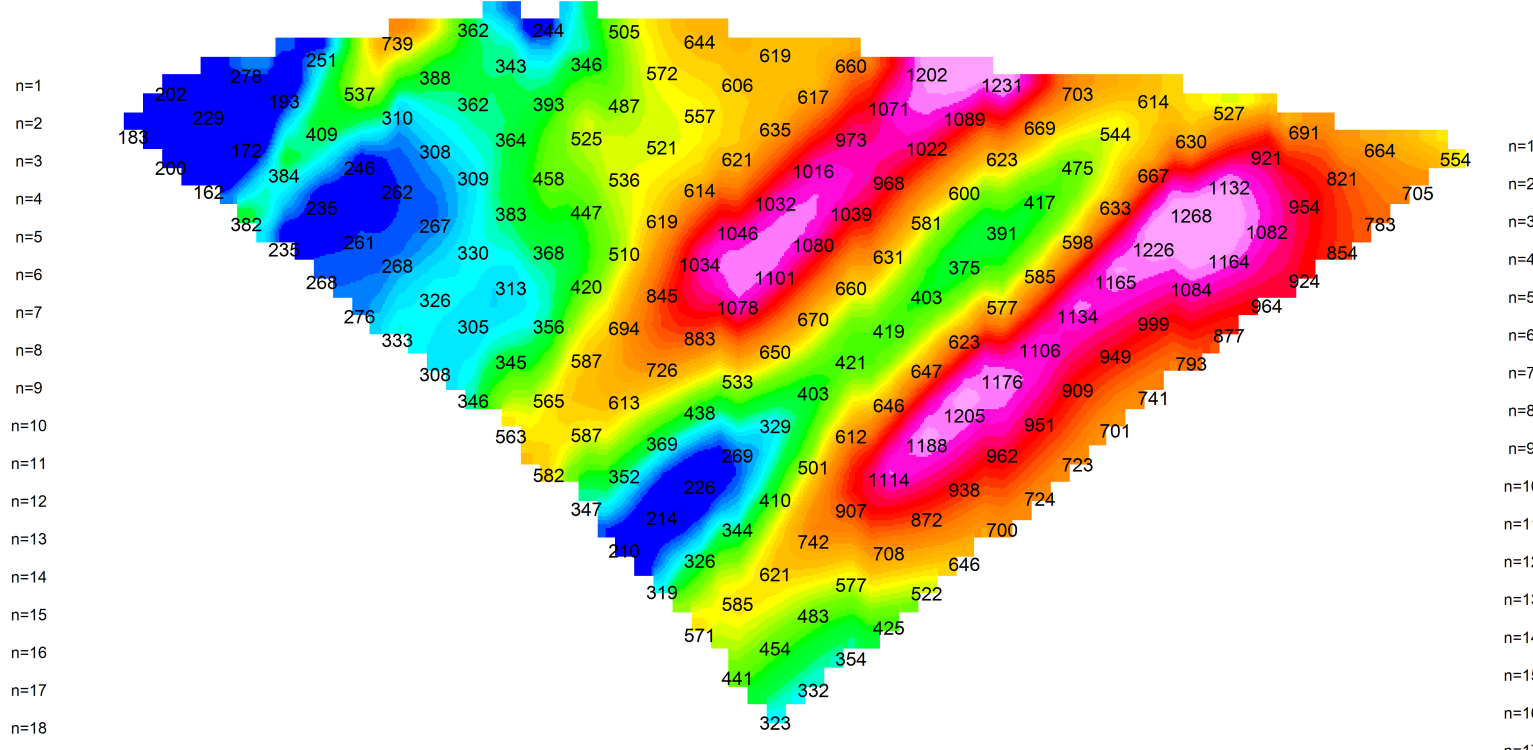

NORTHERN TIGER RESOURCES LTD.

**INDUCED POLARIZATION SURVEY
 DEL GRID
 STACKED PREDICTED APP. RESISTIVITY**

Mining District: Whitehorse
 Date: August 12, 2012

NTS: 115L/07
 Job: NTR-12538-YT

AURORA GEOSCIENCES LTD.