


2014 South Plateau 3D DC/IP Survey

STACKED SECTION

Pole-Dipole Array

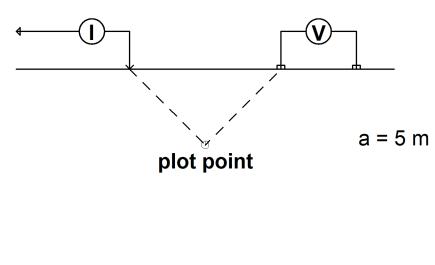

Stationary electrode at 581313E 7017095N

Receivers: Iris ElrecPro

Transmitter: GDD Tx-II 3.6kW

Data File: SouthPlateau_DetailGrid_DC_PredvsObs.gdb

Dates Surveyed : July 30-August 4, 2014

12170.4

11393.7

10666.5

9985.8

9348.5

8751.9

8193.4

7670.5

7181.0

6722.7

6293.6

5892.0

5516.0

5163.9

4834.4

4525.9

4237.0

3966.6

3713.5

3476.5


3254.6

3046.9

2852.5

2670.4

Apparent Resistivity
ohm.m

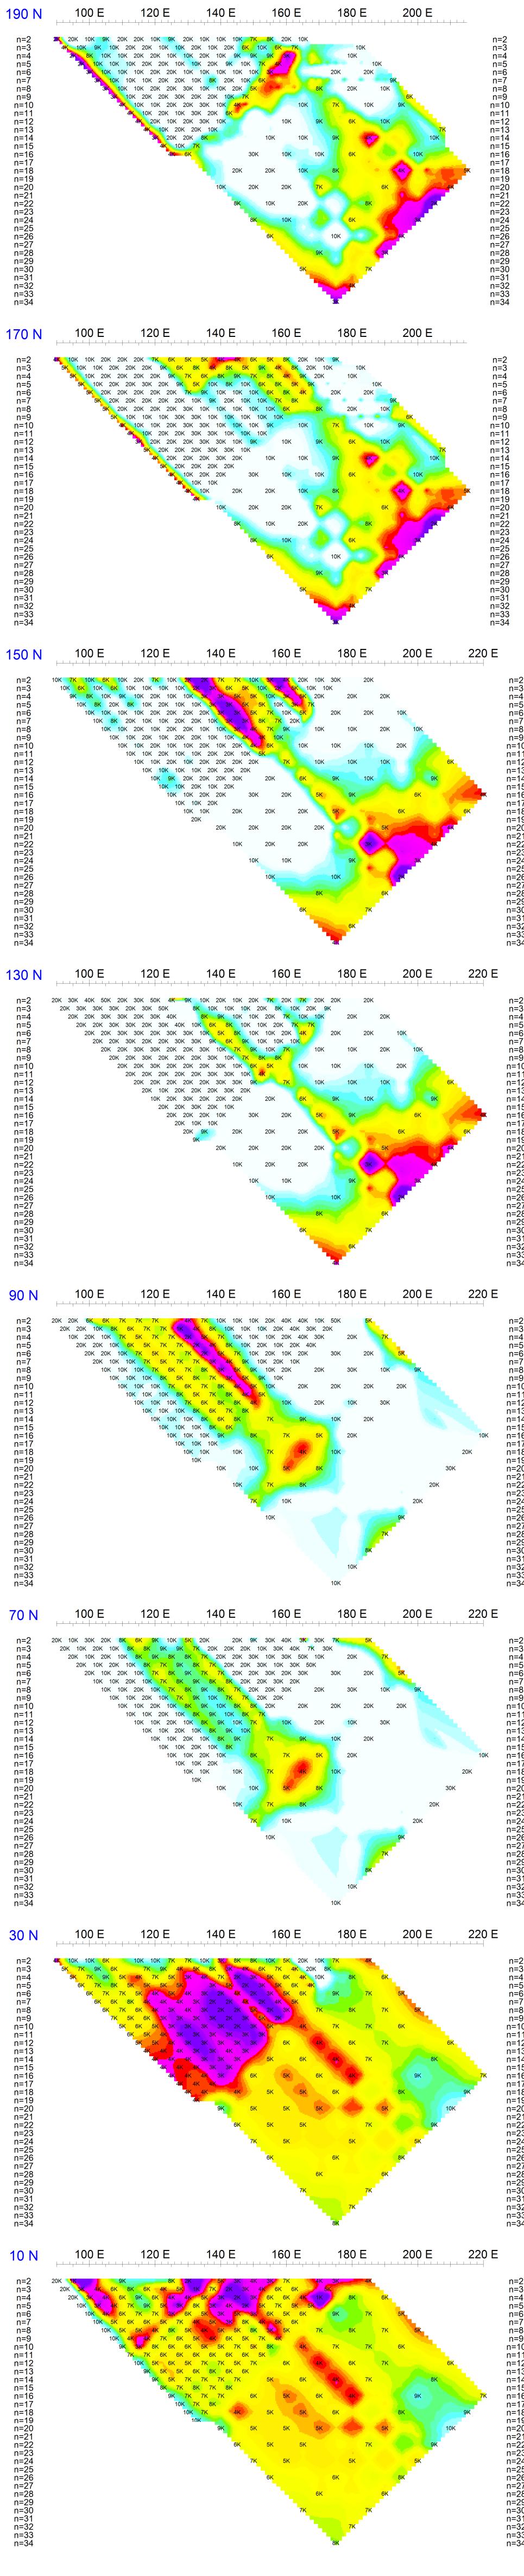

Scale 1:1250
25 0 25 50
(meters)

GOLDSTRIKE RESOURCES LTD.

2014 3D DC/IP SURVEY
Stacked Section Plots - TX east RX
Observed Apparent Resistivity

Date: November 12, 2014 Job#: GSR-14541-YT

AURORA GEOSCIENCES LTD.