


2014 South Plateau 3D DC/IP Survey STACKED SECTION

Pole-Dipole Array

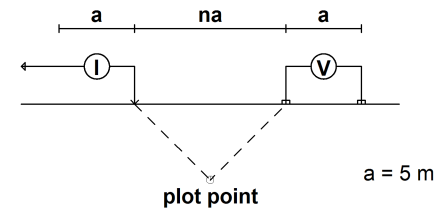

Stationary electrode at 581313E 7017095N


Receivers: Iris ElrecPro

Transmitter: GDD Tx-II 3.6kW


Data File: SouthPlateau_DetailGrid_DC_PredvsObs.gdb

Dates Surveyed : July 30-August 4, 2014


190 N 40 E 60 E 80 E 100 E 120 E 140 E 160 E

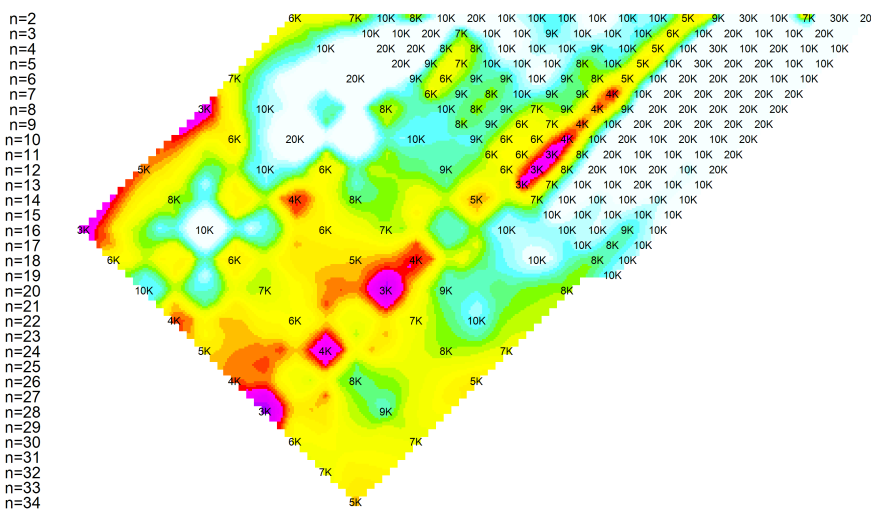


170 N 40 E 60 E 80 E 100 E 120 E 140 E 160 E

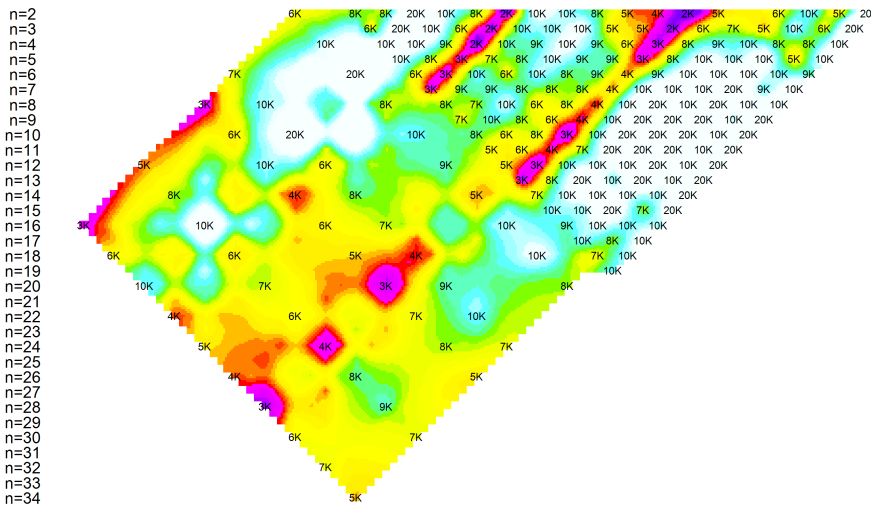


150 N 40 E 60 E 80 E 100 E 120 E 140 E 160 E

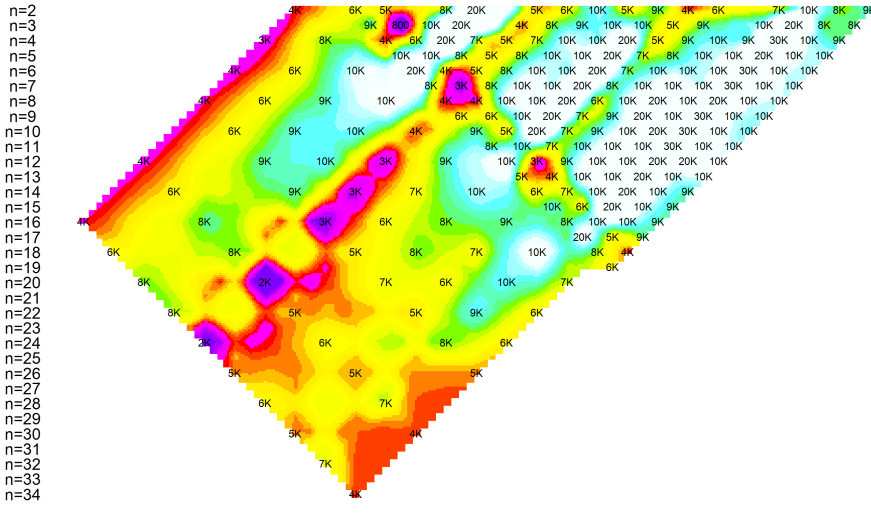


130 N 40 E 60 E 80 E 100 E 120 E 140 E 160 E

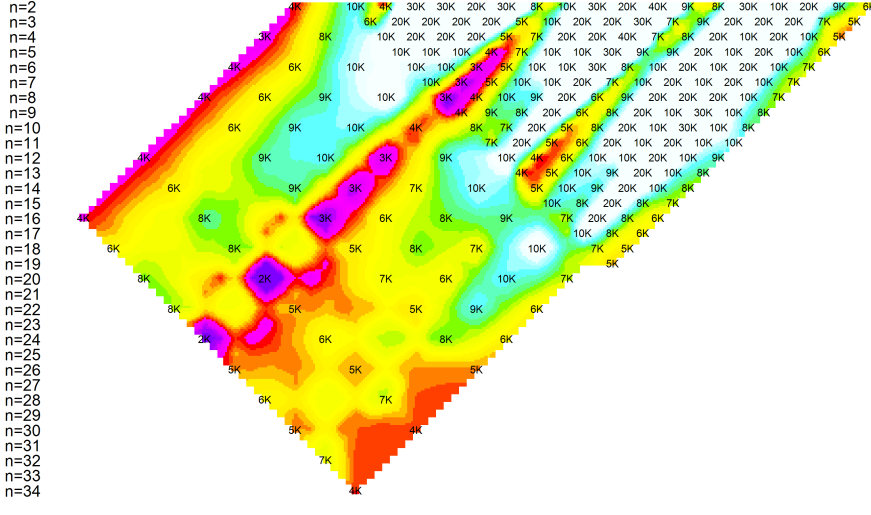


90 N 40 E 60 E 80 E 100 E 120 E 140 E 160 E

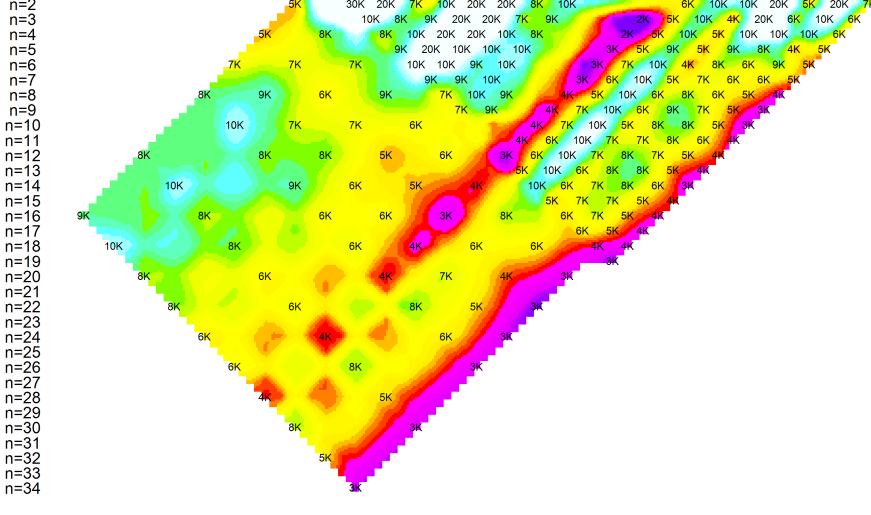



70 N 40 E 60 E 80 E 100 E 120 E 140 E 160 E

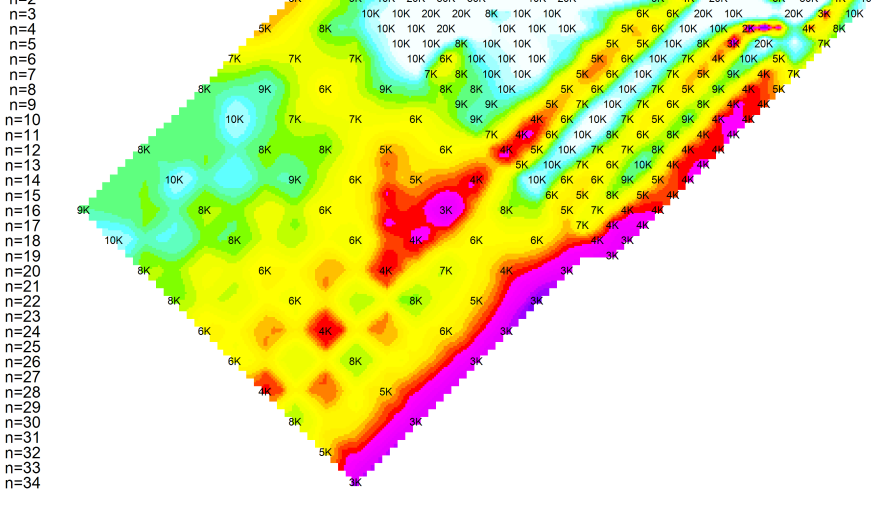


30 N 40 E 60 E 80 E 100 E 120 E 140 E 160 E

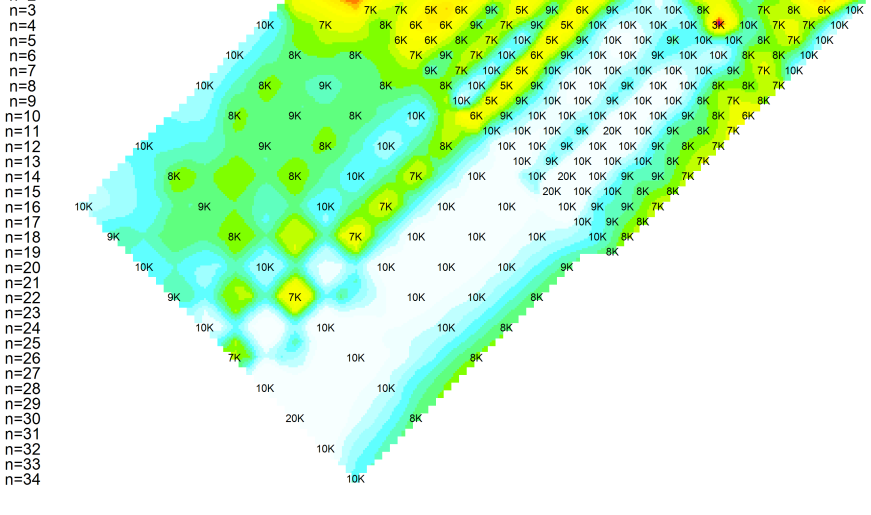

10 N 40 E 60 E 80 E 100 E 120 E 140 E 160 E

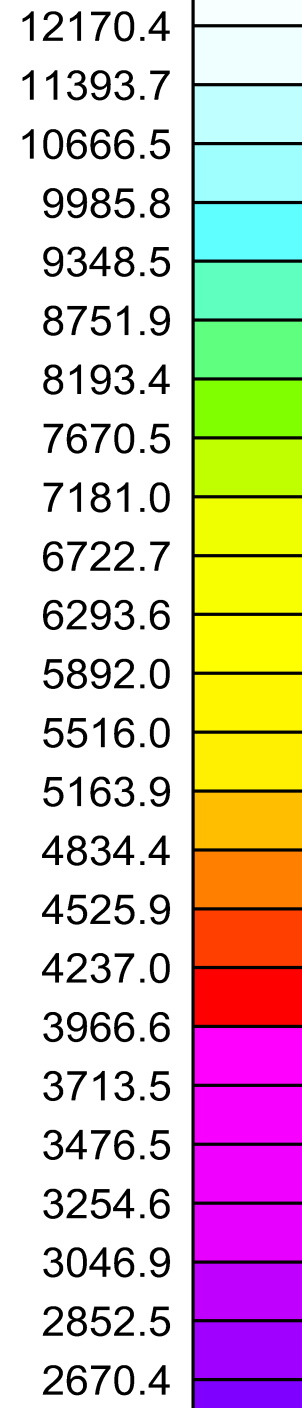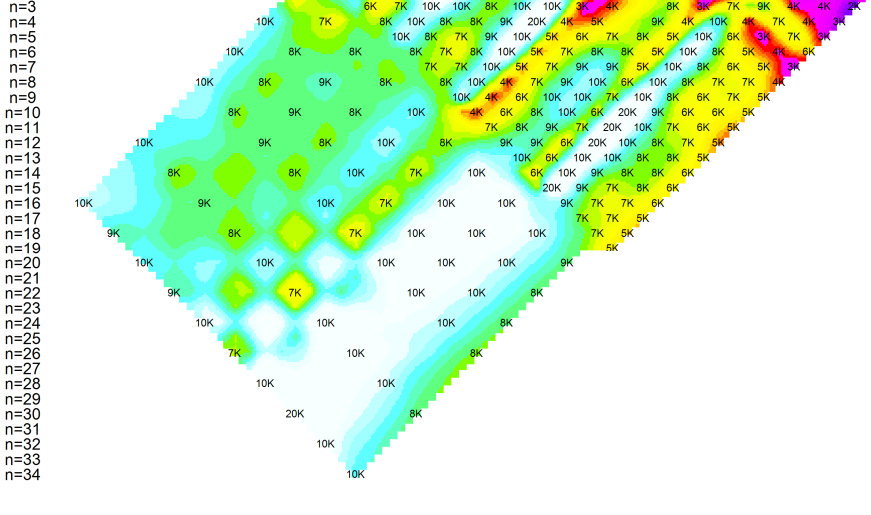

Apparent Resistivity
ohm.m

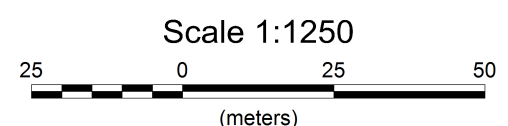

GOLDSTRIKE RESOURCES LTD.

2014 3D DC/IP SURVEY
Stacked Section Plots - TX west of RX
Observed Apparent Resistivity

Date: November 12, 2014

Job#: GSR-14541-YT

AURORA GEOSCIENCES LTD.