

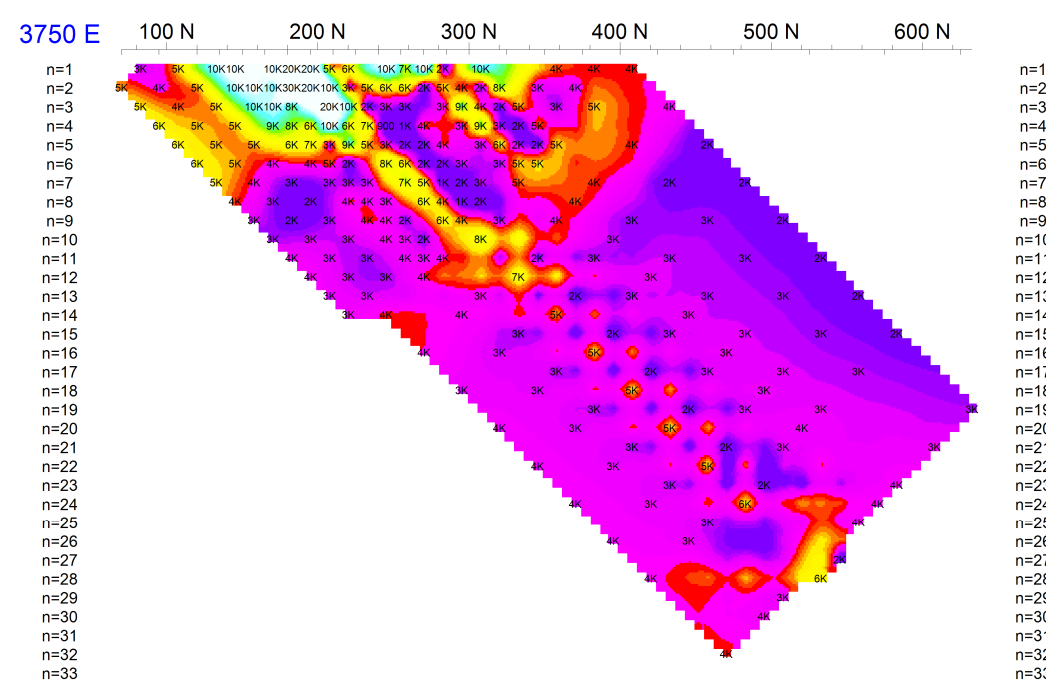
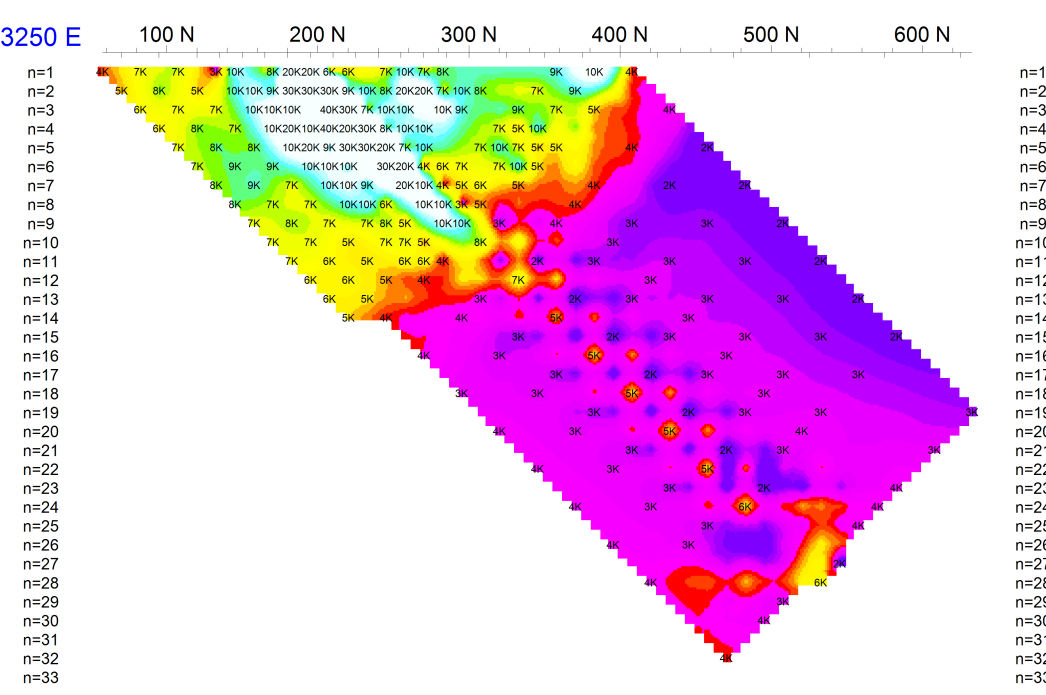
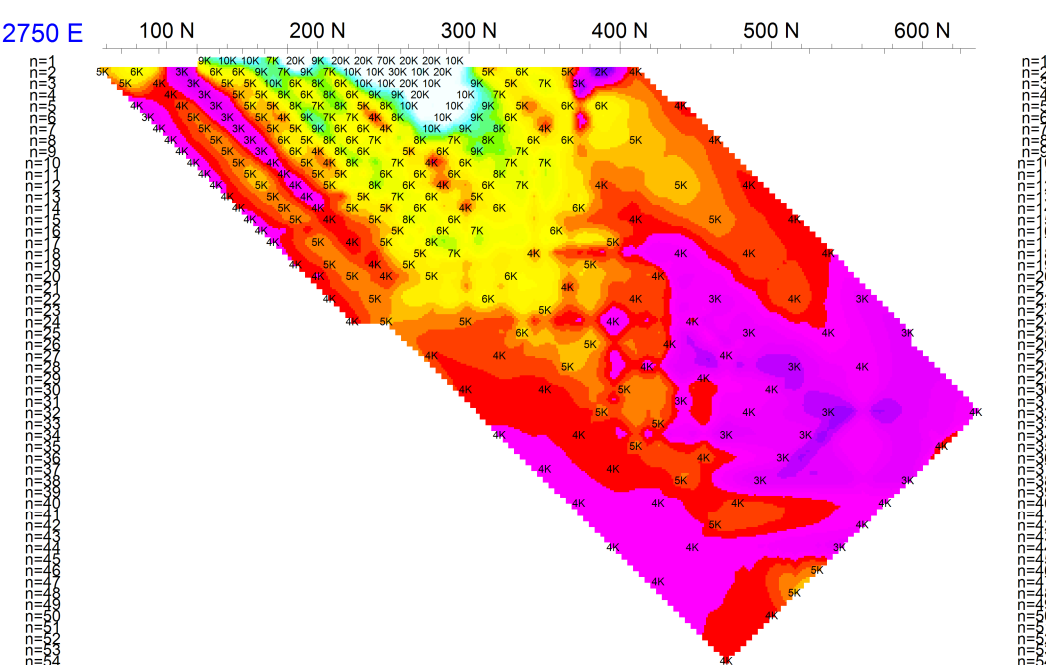
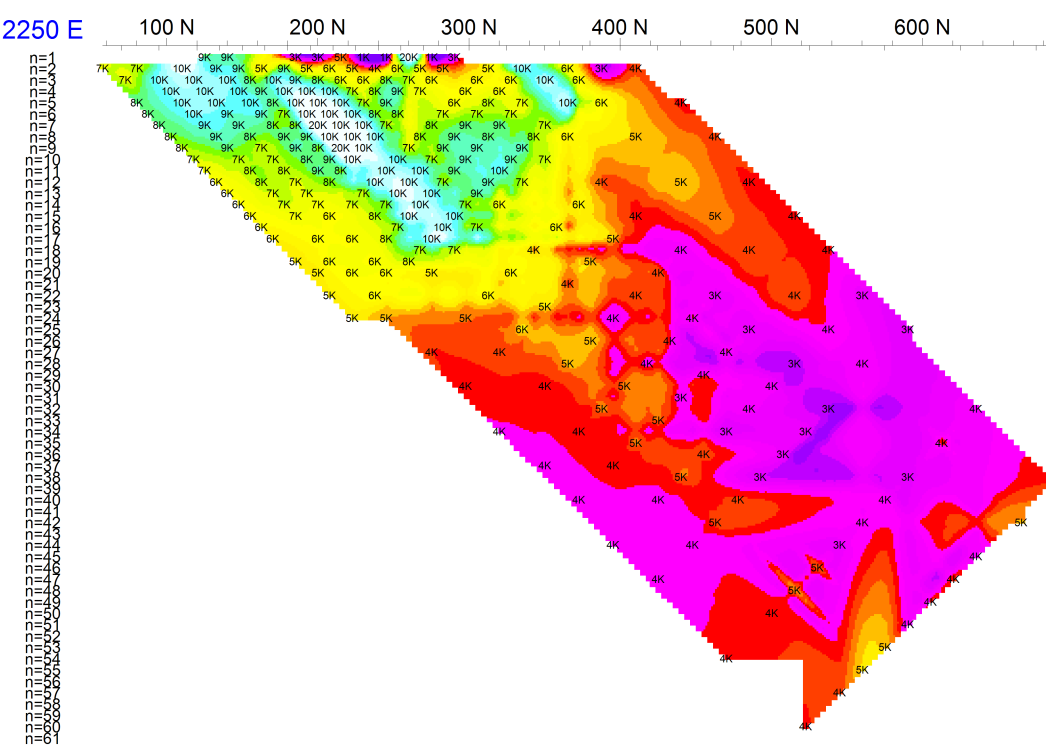
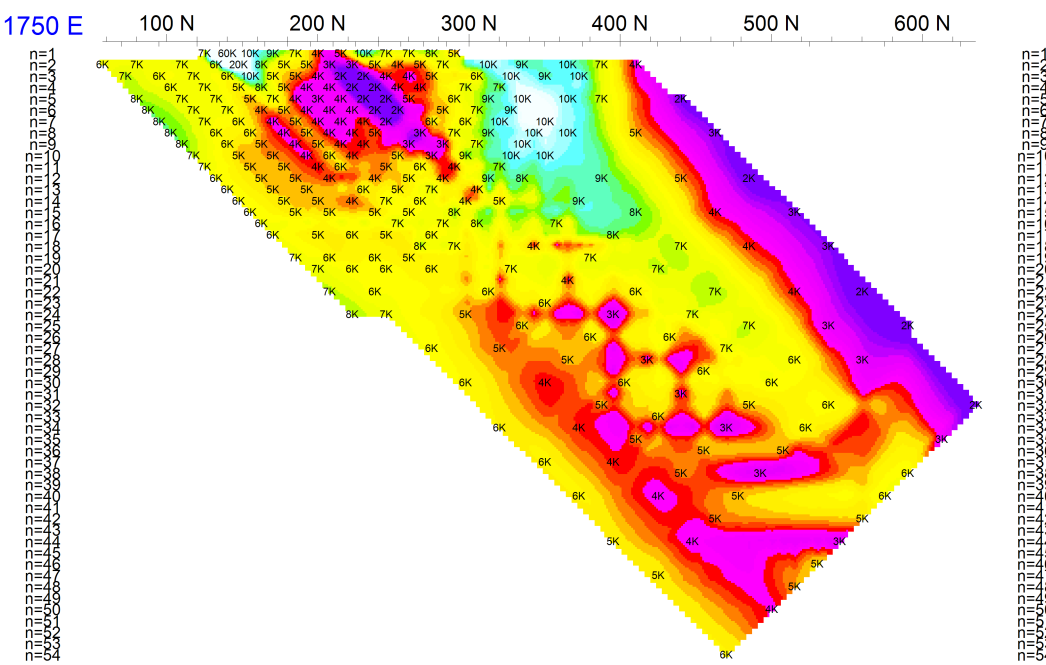


**2014 South Plateau 3D DC/IP Survey
STACKED SECTION**

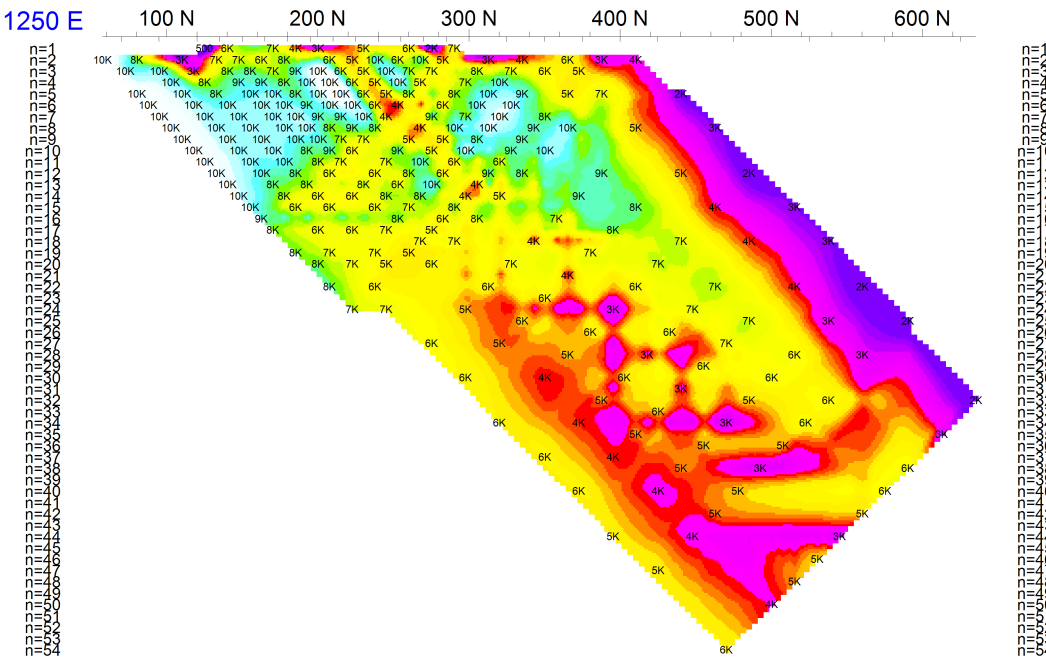

Pole-Dipole Array

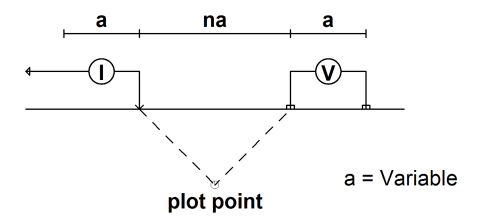

Stationary electrode at 581313E 7017095N

Receivers: Iris ElrecPro


Transmitter: GDD Tx-II 3.6kW

Data File: SouthPlateau_CoarseGrid_DCIP_Final.gdb

Dates Surveyed : July 30-August 4, 2014

- 12170.4
- 11393.7
- 10666.5
- 9985.8
- 9348.5
- 8751.9
- 8193.4
- 7670.5
- 7181.0
- 6722.7
- 6293.6
- 5892.0
- 5516.0
- 5163.9
- 4834.4
- 4525.9
- 4237.0
- 3966.6
- 3713.5
- 3476.5
- 3254.6
- 3046.9
- 2852.5
- 2670.4

Apparent Resistivity
ohm.m

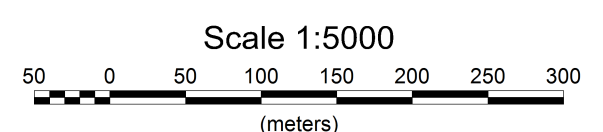

GOLDSTRIKE RESOURCES LTD.

**2014 3D DC/IP SURVEY
Stacked Section Plots - TX north of RX
Predicted Apparent Resistivity**

Date: November 12, 2014 Job#: GSR-14541-YT

AURORA GEOSCIENCES LTD.